



---

# **Bay & Day Commerce Center**

## **NOISE ANALYSIS**

### **CITY OF MORENO VALLEY**

PREPARED BY:

Bill Lawson, PE, INCE  
blawson@urbanxroads.com  
(949) 584-3148

FEBRUARY 19, 2024

---

13796-19 NA



## TABLE OF CONTENTS

<b>TABLE OF CONTENTS</b> .....	<b>III</b>
<b>APPENDICES</b> .....	<b>IV</b>
<b>LIST OF EXHIBITS</b> .....	<b>IV</b>
<b>LIST OF TABLES</b> .....	<b>V</b>
<b>LIST OF ABBREVIATED TERMS</b> .....	<b>VI</b>
<b>EXECUTIVE SUMMARY</b> .....	<b>1</b>
<b>1 INTRODUCTION</b> .....	<b>3</b>
1.1 Site Location.....	3
1.2 Project Description.....	3
<b>2 FUNDAMENTALS</b> .....	<b>7</b>
2.1 Range of Noise .....	7
2.2 Noise Descriptors .....	8
2.3 Sound Propagation.....	8
2.4 Noise Control .....	9
2.5 Noise Barrier Attenuation .....	9
2.6 Land Use Compatibility With Noise .....	10
2.7 Community Response to Noise .....	10
2.8 Vibration .....	11
<b>3 REGULATORY SETTING</b> .....	<b>13</b>
3.1 State of California Noise Requirements.....	13
3.2 City of Moreno Valley General Plan Noise Element .....	13
3.3 Operational Noise Standards .....	15
3.4 Construction Noise Standards .....	16
3.5 Vibration Standards .....	17
3.6 March Air Reserve Base/Inland Port Airport Land Use Compatibility .....	18
<b>4 SIGNIFICANCE CRITERIA</b> .....	<b>21</b>
4.1 Noise Level Increases (Threshold A) .....	21
4.2 Vibration (Threshold B).....	22
4.3 CEQA Guidelines Not Further Analyzed (Threshold C) .....	22
4.3 Significance Criteria Summary .....	23
<b>5 EXISTING NOISE LEVEL MEASUREMENTS</b> .....	<b>25</b>
5.1 Measurement Procedure and Criteria .....	25
5.2 Noise Measurement Locations .....	25
5.3 Noise Measurement Results .....	26
<b>6 SENSITIVE RECEIVER LOCATIONS</b> .....	<b>29</b>
<b>7 OPERATIONAL NOISE IMPACTS</b> .....	<b>31</b>
7.1 Operational Noise Sources.....	31
7.2 Reference Noise Levels .....	31
7.2.1 Measurement Procedures .....	31
7.3 CadnaA Noise Prediction Model .....	34
7.4 Project Operational Noise Levels.....	35
7.5 Project Operational Noise Level Compliance.....	36

7.6 Project Operational Noise Level Increases ..... 37

**8 CONSTRUCTION IMPACTS..... 41**

8.1 Construction Noise Levels..... 41

8.2 Construction Reference Noise Levels ..... 41

8.3 Construction Noise Analysis..... 43

8.4 Construction Noise Level Compliance ..... 44

8.5 Nighttime Concrete Pour Noise Analysis ..... 45

8.6 Construction Vibration Analysis..... 47

**9 REFERENCES..... 49**

**10 CERTIFICATION..... 51**

**APPENDICES**

- APPENDIX 3.1: CITY OF MORENO VALLEY MUNICIPAL CODE
- APPENDIX 5.1: STUDY AREA PHOTOS
- APPENDIX 5.2: NOISE LEVEL MEASUREMENT WORKSHEETS
- APPENDIX 7.1: CADNAA OPERATIONAL NOISE MODEL INPUTS
- APPENDIX 8.1: CADNAA CONSTRUCTION NOISE MODEL INPUTS
- APPENDIX 8.2: CADNAA NIGHTTIME CONCRETE POUR NOISE MODEL INPUTS

**LIST OF EXHIBITS**

EXHIBIT 1-A: LOCATION MAP..... 4

EXHIBIT 1-B: SITE PLAN..... 5

EXHIBIT 2-A: TYPICAL NOISE LEVELS..... 7

EXHIBIT 2-B: NOISE LEVEL INCREASE PERCEPTION ..... 10

EXHIBIT 2-C: TYPICAL LEVELS OF GROUND-BORNE VIBRATION..... 12

EXHIBIT 3-A: LAND USE NOISE COMPATIBILITY CRITERIA ..... 14

EXHIBIT 3-B: FUTURE AIRPORT NOISE LEVEL CONTOURS ..... 19

EXHIBIT 5-A: NOISE MEASUREMENT LOCATIONS..... 27

EXHIBIT 6-A: SENSITIVE RECEIVER LOCATIONS..... 30

EXHIBIT 7-A: OPERATIONAL NOISE SOURCE LOCATIONS ..... 32

EXHIBIT 8-A: CONSTRUCTION NOISE SOURCE LOCATIONS ..... 42

EXHIBIT 8-B: NIGHTTIME CONCRETE POUR NOISE SOURCE AND RECEIVER LOCATIONS..... 46

**LIST OF TABLES**

**TABLE ES-1: SUMMARY OF CEQA SIGNIFICANCE FINDINGS ..... 1**  
**TABLE 3-1: OPERATIONAL NOISE STANDARDS AT 200 FEET FROM THE SOURCE ..... 16**  
**TABLE 3-2: CONSTRUCTION NOISE STANDARDS AT 200 FEET FROM THE SOURCE ..... 17**  
**TABLE 4-1: SIGNIFICANCE CRITERIA SUMMARY ..... 23**  
**TABLE 5-1: 24-HOUR AMBIENT NOISE LEVEL MEASUREMENTS ..... 26**  
**TABLE 7-1: REFERENCE NOISE LEVEL MEASUREMENTS..... 33**  
**TABLE 7-2: DAYTIME PROJECT OPERATIONAL NOISE LEVELS..... 35**  
**TABLE 7-3: NIGHTTIME PROJECT OPERATIONAL NOISE LEVELS ..... 36**  
**TABLE 7-4: OPERATIONAL NOISE LEVEL COMPLIANCE..... 36**  
**TABLE 7-5: DAYTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES ..... 38**  
**TABLE 7-6: NIGHTTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES..... 39**  
**TABLE 8-1: TYPICAL CONSTRUCTION REFERENCE NOISE LEVELS ..... 43**  
**TABLE 8-2: CONSTRUCTION EQUIPMENT NOISE LEVEL SUMMARY ..... 44**  
**TABLE 8-3: TYPICAL CONSTRUCTION NOISE LEVEL COMPLIANCE ..... 44**  
**TABLE 8-4: NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE ..... 47**  
**TABLE 8-5: VIBRATION SOURCE LEVELS FOR CONSTRUCTION EQUIPMENT ..... 47**  
**TABLE 8-6: CONSTRUCTION EQUIPMENT VIBRATION LEVELS ..... 48**

## **LIST OF ABBREVIATED TERMS**

(1)	Reference
ADT	Average Daily Traffic
ANSI	American National Standards Institute
CEQA	California Environmental Quality Act
CNEL	Community Noise Equivalent Level
dBA	A-weighted decibels
EPA	Environmental Protection Agency
FHWA	Federal Highway Administration
FTA	Federal Transit Administration
Hz	Hertz
INCE	Institute of Noise Control Engineering
$L_{eq}$	Equivalent continuous (average) sound level
$L_{max}$	Maximum level measured over the time interval
$L_{min}$	Minimum level measured over the time interval
MARB/IPA	March Air Reserve Base / Inland Port Airport
OPR	Office of Planning and Research
PPV	Peak particle velocity
Project	Bay & Day Commerce Center
REMEL	Reference Energy Mean Emission Level
RMS	Root-mean-square
VdB	Vibration Decibels

## EXECUTIVE SUMMARY

Urban Crossroads, Inc. has prepared this noise study to determine the potential noise impacts and the necessary noise mitigation measures, if any, for the proposed Bay & Day Commerce Center development (“Project”). The Project site is located on the southwestern corner of Day Street and Bay Avenue in the City of Moreno Valley. The Project is proposed to consist of a 194,775 square foot warehouse building.

The results of this Bay & Day Commerce Center Noise Analysis are summarized below based on the significance criteria in Section 4 of this report consistent with Appendix G of the California Environmental Quality Act (CEQA) Guidelines (1). Table ES-1 shows the findings of significance for each potential noise and/or vibration impact under CEQA.

**TABLE ES-1: SUMMARY OF CEQA SIGNIFICANCE FINDINGS**

Analysis	Report Section	Significance Findings	
		Unmitigated	Mitigated
Operational Noise	7	<i>Less Than Significant</i>	-
Construction Noise	8	<i>Less Than Significant</i>	-
Construction Vibration		<i>Less Than Significant</i>	-
Nighttime Concrete Pour		<i>Less Than Significant</i>	-

*This page intentionally left blank*

# **1 INTRODUCTION**

This noise analysis has been completed to determine the noise impacts associated with the development of the proposed Bay & Day Commerce Center (“Project”). This noise study briefly describes the proposed Project, provides information regarding noise fundamentals, sets out the local regulatory setting, presents the study methods and procedures for noise analysis, and evaluates the future exterior noise environment. In addition, this study includes an analysis of the potential Project-related long-term stationary-source operational noise and short-term construction noise and vibration impacts.


## **1.1 SITE LOCATION**

The proposed project is located on the southwestern corner of Day Street and Bay Avenue in the City of Moreno Valley as shown on Exhibit 1-A. The March Air Reserve Base/Inland Port Airport (MARB/IPA) boundary is located approximately 0.6 miles south of the Project site. The Project site is bordered to the north, south, east, by residential uses. The Phelan Development industrial park is currently under construction west of the Project site.

## **1.2 PROJECT DESCRIPTION**

The Project is proposed to consist of a 194,775 square foot warehouse building (75% general warehousing use and 25% high-cube cold storage warehouse use) as shown on Exhibit 1-B. The on-site Project-related noise sources are expected to include: loading dock activity, roof-top air conditioning units, trash enclosure activity, parking lot vehicle movements, and truck movements. This noise analysis is intended to describe noise level impacts associated with the expected typical operational activities at the Project site.

EXHIBIT 1-A: LOCATION MAP

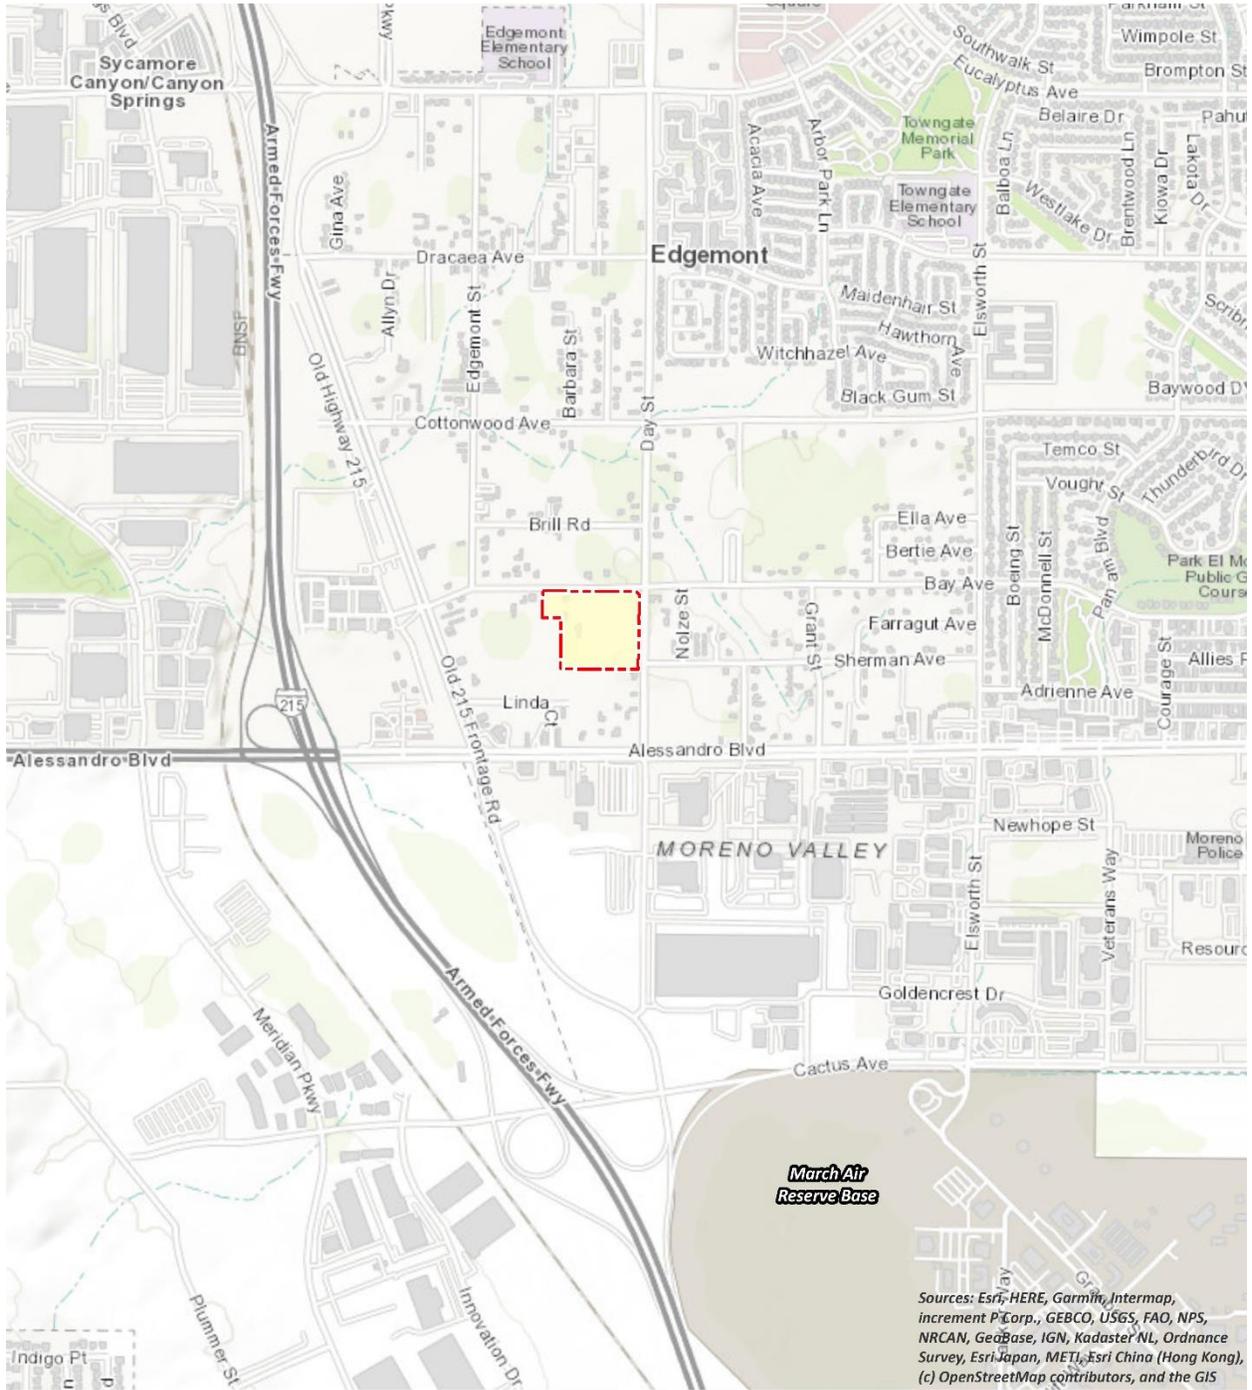

Sources: Esri, HERE, Garmin, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), (c) OpenStreetMap contributors, and the GIS

**LEGEND:**  
N  
[Red dashed box] Site Boundary



*This page intentionally left blank*

## 2 FUNDAMENTALS

Noise is simply defined as "unwanted sound." Sound becomes unwanted when it interferes with normal activities, when it causes actual physical harm or when it has adverse effects on health. Noise is measured on a logarithmic scale of sound pressure level known as a decibel (dB). A-weighted decibels (dBA) approximate the subjective response of the human ear to broad frequency noise source by discriminating against very low and very high frequencies of the audible spectrum. They are adjusted to reflect only those frequencies which are audible to the human ear. Exhibit 2-A presents a summary of the typical noise levels and their subjective loudness and effects that are described in more detail below.

**EXHIBIT 2-A: TYPICAL NOISE LEVELS**

<b>COMMON OUTDOOR ACTIVITIES</b>	<b>COMMON INDOOR ACTIVITIES</b>	<b>A - WEIGHTED SOUND LEVEL dBA</b>	<b>SUBJECTIVE LOUDNESS</b>	<b>EFFECTS OF NOISE</b>
THRESHOLD OF PAIN		140	<b>INTOLERABLE OR DEAFENING</b>	<b>HEARING LOSS</b>
NEAR JET ENGINE		130		
		120		
JET FLY-OVER AT 300m (1000 ft)	ROCK BAND	110		
LOUD AUTO HORN		100	<b>VERY NOISY</b>	<b>SPEECH INTERFERENCE</b>
GAS LAWN MOWER AT 1m (3 ft)		90		
DIESEL TRUCK AT 15m (50 ft), at 80 km/hr (50 mph)	FOOD BLENDER AT 1m (3 ft)	80	<b>LOUD</b>	
NOISY URBAN AREA, DAYTIME	VACUUM CLEANER AT 3m (10 ft)	70		
HEAVY TRAFFIC AT 90m (300 ft)	NORMAL SPEECH AT 1m (3 ft)	60	<b>MODERATE</b>	<b>SLEEP DISTURBANCE</b>
QUIET URBAN DAYTIME	LARGE BUSINESS OFFICE	50		
QUIET URBAN NIGHTTIME	THEATER, LARGE CONFERENCE ROOM (BACKGROUND)	40	<b>FAINT</b>	<b>NO EFFECT</b>
QUIET SUBURBAN NIGHTTIME	LIBRARY	30		
QUIET RURAL NIGHTTIME	BEDROOM AT NIGHT, CONCERT HALL (BACKGROUND)	20		
	BROADCAST/RECORDING STUDIO	10	<b>VERY FAINT</b>	
LOWEST THRESHOLD OF HUMAN HEARING	LOWEST THRESHOLD OF HUMAN HEARING	0		

Source: Environmental Protection Agency Office of Noise Abatement and Control, Information on Levels of Environmental Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety (EPA/ONAC 550/9-74-004) March 1974.

### 2.1 RANGE OF NOISE

Since the range of intensities that the human ear can detect is so large, the scale frequently used to measure intensity is a scale based on multiples of 10, the logarithmic scale. The scale for measuring intensity is the decibel scale. Each interval of 10 decibels indicates a sound energy ten times greater than before, which is perceived by the human ear as being roughly twice as loud. (2) The most common sounds vary between 40 dBA (very quiet) to 100 dBA (very loud). Normal conversation at three feet is roughly at 60 dBA, while loud jet engine noises equate to 110 dBA

at approximately 1,000 feet, which can cause serious discomfort. (3) Another important aspect of noise is the duration of the sound and the way it is described and distributed in time.

## 2.2 NOISE DESCRIPTORS

Environmental noise descriptors are generally based on averages, rather than instantaneous, noise levels. The most used metric is the equivalent level ( $L_{eq}$ ). Equivalent sound levels are not measured directly but are calculated from sound pressure levels typically measured in A-weighted decibels (dBA). The equivalent sound level ( $L_{eq}$ ) represents a steady state sound level containing the same total energy as a time varying signal over a given sample period and is commonly used to describe the “average” noise levels within the environment.

Peak hour or average noise levels, while useful, do not completely describe a given noise environment. Noise levels lower than peak hour may be disturbing if they occur during times when quiet is most desirable, namely evening and nighttime (sleeping) hours. To account for this, the Community Noise Equivalent Level (CNEL), representing a composite 24-hour noise level is utilized. The CNEL is the weighted average of the intensity of a sound, with corrections for time of day, and averaged over 24 hours. The time-of-day corrections require the addition of 5 decibels to dBA  $L_{eq}$  sound levels in the evening from 7:00 p.m. to 10:00 p.m., and the addition of 10 decibels to dBA  $L_{eq}$  sound levels at night between 10:00 p.m. and 7:00 a.m. These additions are made to account for the noise sensitive time periods during the evening and night hours when noise can become more intrusive. CNEL does not represent the actual sound level heard at any time, but rather represents the total sound exposure. The City of Moreno Valley relies on the 24-hour CNEL level to assess land use compatibility with transportation related noise sources.

## 2.3 SOUND PROPAGATION

When sound propagates over a distance, it changes in level and frequency content. The way noise reduces with distance depends on the following factors.

### 2.3.1 GEOMETRIC SPREADING

Sound from a localized source (i.e., a stationary point source) propagates uniformly outward in a spherical pattern. The sound level attenuates (or decreases) at a rate of 6 dB for each doubling of distance from a point source. Highways consist of several localized noise sources on a defined path and hence can be treated as a line source, which approximates the effect of several point sources. Noise from a line source propagates outward in a cylindrical pattern, often referred to as cylindrical spreading. Sound levels attenuate at a rate of 3 dB for each doubling of distance from a line source. (2)

### 2.3.2 GROUND ABSORPTION

The propagation path of noise from a highway to a receiver is usually very close to the ground. Noise attenuation from ground absorption and reflective wave canceling adds to the attenuation associated with geometric spreading. Traditionally, the excess attenuation has also been expressed in terms of attenuation per doubling of distance. This approximation is usually

sufficiently accurate for distances of less than 200 ft. For acoustically hard sites (i.e., sites with a reflective surface between the source and the receiver, such as a parking lot or body of water), no excess ground attenuation is assumed. For acoustically absorptive or soft sites (i.e., those sites with an absorptive ground surface between the source and the receiver such as soft dirt, grass, or scattered bushes and trees), an excess ground attenuation value of 1.5 dB per doubling of distance is normally assumed. When added to the cylindrical spreading, the excess ground attenuation results in an overall drop-off rate of 4.5 dB per doubling of distance from a line source. (4)

### **2.3.3 ATMOSPHERIC EFFECTS**

Receivers located downwind from a source can be exposed to increased noise levels relative to calm conditions, whereas locations upwind can have lowered noise levels. Sound levels can be increased at large distances (e.g., more than 500 feet) due to atmospheric temperature inversion (i.e., increasing temperature with elevation). Other factors such as air temperature, humidity, and turbulence can also have significant effects. (2)

### **2.3.4 SHIELDING**

A large object or barrier in the path between a noise source and a receiver can substantially attenuate noise levels at the receiver. The amount of attenuation provided by shielding depends on the size of the object and the frequency content of the noise source. Shielding by trees and other such vegetation typically only has an “out of sight, out of mind” effect. That is, the perception of noise impact tends to decrease when vegetation blocks the line-of-sight to nearby residents. However, for vegetation to provide a substantial, or even noticeable, noise reduction, the vegetation area must be at least 15 feet in height, 100 feet wide and dense enough to completely obstruct the line-of-sight between the source and the receiver. This size of vegetation may provide up to 5 dBA of noise reduction. The Federal Highway Administration (FHWA) does not consider the planting of vegetation to be a noise abatement measure. (5)

## **2.4 NOISE CONTROL**

Noise control is the process of obtaining an acceptable noise environment for an observation point or receiver by controlling the noise source, transmission path, receiver, or all three. This concept is known as the source-path-receiver concept. In general, noise control measures can be applied to these three elements.

## **2.5 NOISE BARRIER ATTENUATION**

Effective noise barriers can reduce noise levels by 10 to 15 dBA, cutting the loudness of traffic noise in half. A noise barrier is most effective when placed close to the noise source or receiver. Noise barriers, however, do have limitations. For a noise barrier to work, it must block the line-of-sight path of sound from the noise source.

## 2.6 LAND USE COMPATIBILITY WITH NOISE


Some land uses are more tolerant of noise than others. For example, schools, hospitals, churches, and residences are more sensitive to noise intrusion than are commercial or industrial developments and related activities. As ambient noise levels affect the perceived amenity or livability of a development, so too can the mismanagement of noise impacts impair the economic health and growth potential of a community by reducing the area’s desirability as a place to live, shop and work. For this reason, land use compatibility with the noise environment is an important consideration in the planning and design process. The FHWA encourages State and Local government to regulate land development in such a way that noise-sensitive land uses are either prohibited from being located adjacent to a highway, or that the developments are planned, designed, and constructed in such a way that noise impacts are minimized. (6)

## 2.7 COMMUNITY RESPONSE TO NOISE

Approximately sixteen percent of the population has a very low tolerance for noise and will object to any noise not of their making. Consequently, even in the quietest environment, some complaints may occur. Twenty to thirty percent of the population will not complain even in very severe noise environments. (7 pp. 8-6) Thus, a variety of reactions can be expected from people exposed to any given noise environment.

Surveys have shown that community response to noise varies from no reaction to vigorous action for newly introduced noises averaging from 10 dB below existing to 25 dB above existing. (8) According to research originally published in the Noise Effects Handbook (7), the percentage of high annoyance ranges from approximately 0 percent at 45 dB or less, 10 percent are highly annoyed around 60 dB, and increases rapidly to approximately 70 percent being highly annoyed at approximately 85 dB or greater. Despite this variability in behavior on an individual level, the population can be expected to exhibit the following responses to changes in noise levels as shown on Exhibit 2-B. A change of 3 dBA is considered barely perceptible, and changes of 5 dBA are considered readily perceptible. (4)

**EXHIBIT 2-B: NOISE LEVEL INCREASE PERCEPTION**

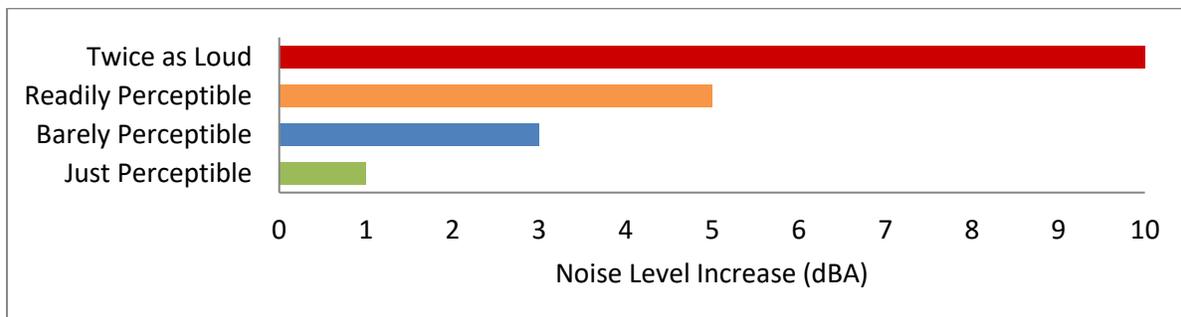


## 2.8 VIBRATION

Per the Federal Transit Administration (FTA) *Transit Noise Impact and Vibration Impact Assessment Manual* (8), vibration is the periodic oscillation of a medium or object. The rumbling sound caused by the vibration of room surfaces is called structure-borne noise. Sources of ground-borne vibrations include natural phenomena (e.g., earthquakes, volcanic eruptions, sea waves, landslides) or human-made causes (e.g., explosions, machinery, traffic, trains, construction equipment). Vibration sources may be continuous, such as factory machinery, or transient, such as explosions. As is the case with airborne sound, ground-borne vibrations may be described by amplitude and frequency.

There are several different methods that are used to quantify vibration. The peak particle velocity (PPV) is defined as the maximum instantaneous peak of the vibration signal. The PPV is most frequently used to describe vibration impacts to buildings but is not always suitable for evaluating human response (annoyance) because it takes some time for the human body to respond to vibration signals. Instead, the human body responds to average vibration amplitude often described as the root mean square (RMS). The RMS amplitude is defined as the average of the squared amplitude of the signal and is most frequently used to describe the effect of vibration on the human body. Decibel notation (VdB) is commonly used to measure RMS. Decibel notation (VdB) serves to reduce the range of numbers used to describe human response to vibration. Typically, ground-borne vibration generated by man-made activities attenuates rapidly with distance from the source of the vibration. Sensitive receivers for vibration include structures (especially older masonry structures), people (especially residents, the elderly, and sick), and vibration-sensitive equipment and/or activities.

The background vibration-velocity level in residential areas is generally 50 VdB. Ground-borne vibration is normally perceptible to humans at approximately 65 VdB. For most people, a vibration-velocity level of 75 VdB is the approximate dividing line between barely perceptible and distinctly perceptible levels. Typical outdoor sources of perceptible ground-borne vibration are construction equipment, steel-wheeled trains, and traffic on rough roads. If a roadway is smooth, the ground-borne vibration is rarely perceptible. The range of interest is from approximately 50 VdB, which is the typical background vibration-velocity level, to 100 VdB, which is the general threshold where minor damage can occur in fragile buildings. Exhibit 2-C illustrates common vibration sources and the human and structural response to ground-borne vibration.

**EXHIBIT 2-C: TYPICAL LEVELS OF GROUND-BORNE VIBRATION**

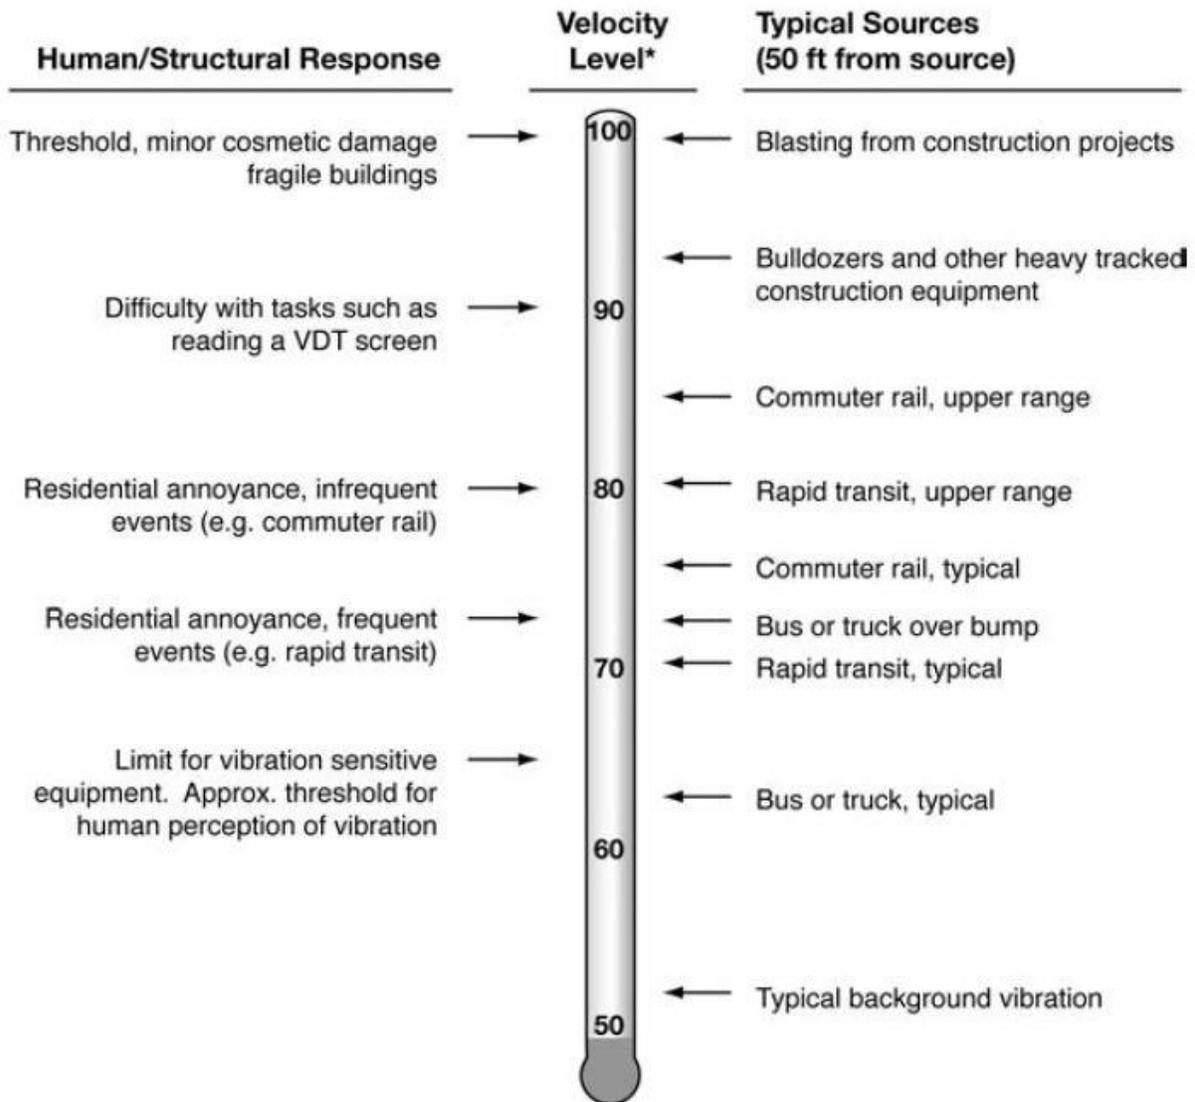

\* RMS Vibration Velocity Level in VdB relative to  $10^{-6}$  inches/second

Source: Federal Transit Administration (FTA) Transit Noise and Vibration Impact Assessment Manual.

### 3 REGULATORY SETTING

To limit population exposure to physically and/or psychologically damaging as well as intrusive noise levels, the federal government, the State of California, various county governments, and most municipalities in the state have established standards and ordinances to control noise. In most areas, automobile and truck traffic is the major source of environmental noise. Traffic activity generally produces an average sound level that remains constant with time. Air and rail traffic, and commercial and industrial activities are also major sources of noise in some areas. Federal, state, and local agencies regulate different aspects of environmental noise. Federal and state agencies generally set noise standards for mobile sources such as aircraft and motor vehicles, while regulation of stationary sources is left to local agencies.

#### 3.1 STATE OF CALIFORNIA NOISE REQUIREMENTS


The State of California regulates freeway noise, sets standards for sound transmission, provides occupational noise control criteria, identifies noise standards, and provides guidance for local land use compatibility. State law requires that each county and city adopt a General Plan that includes a Noise Element which is to be prepared per guidelines adopted by the Governor's Office of Planning and Research (OPR). (9) The purpose of the Noise Element is to *limit the exposure of the community to excessive noise levels*. In addition, the California Environmental Quality Act (CEQA) requires that all known environmental effects of a project be analyzed, including environmental noise impacts.

#### 3.2 CITY OF MORENO VALLEY GENERAL PLAN NOISE ELEMENT

The City of Moreno Valley Noise Element typically provides the standards for land use compatibility for community noise exposure. However, the City of Moreno Valley General Plan does not include a noise element or specific transportation-related noise standards. Rather, noise is considered in the Environmental Safety section of the General Plan Safety Element. (10) While the General Plan provides background and noise fundamentals, it does not identify criteria to assess the impacts associated with off-site transportation-related noise impacts. Therefore, for this analysis, the transportation noise criteria are derived from standards contained in the California Office of Planning and Research (OPR) *General Plan Guidelines*. (9)

The OPR land use/noise compatibility standards are used by many California cities and counties and specify the maximum noise levels allowable for new developments impacted by transportation noise sources. The OPR land use/noise compatibility criteria, found in Figure 2 of the *General Plan Guidelines, Appendix D: Noise Element Guidelines*, identify the criteria for industrial land uses such as the Project, as shown on Exhibit 3-A. When the unmitigated exterior noise levels approach 70 dBA CNEL industrial land use is considered *normally acceptable*. With exterior noise levels ranging from 70 to 80 dBA CNEL, industrial land uses are considered *conditionally acceptable*, and with exterior noise levels greater than 80 dBA CNEL, they are considered *normally unacceptable*.

**EXHIBIT 3-A: LAND USE NOISE COMPATIBILITY CRITERIA**

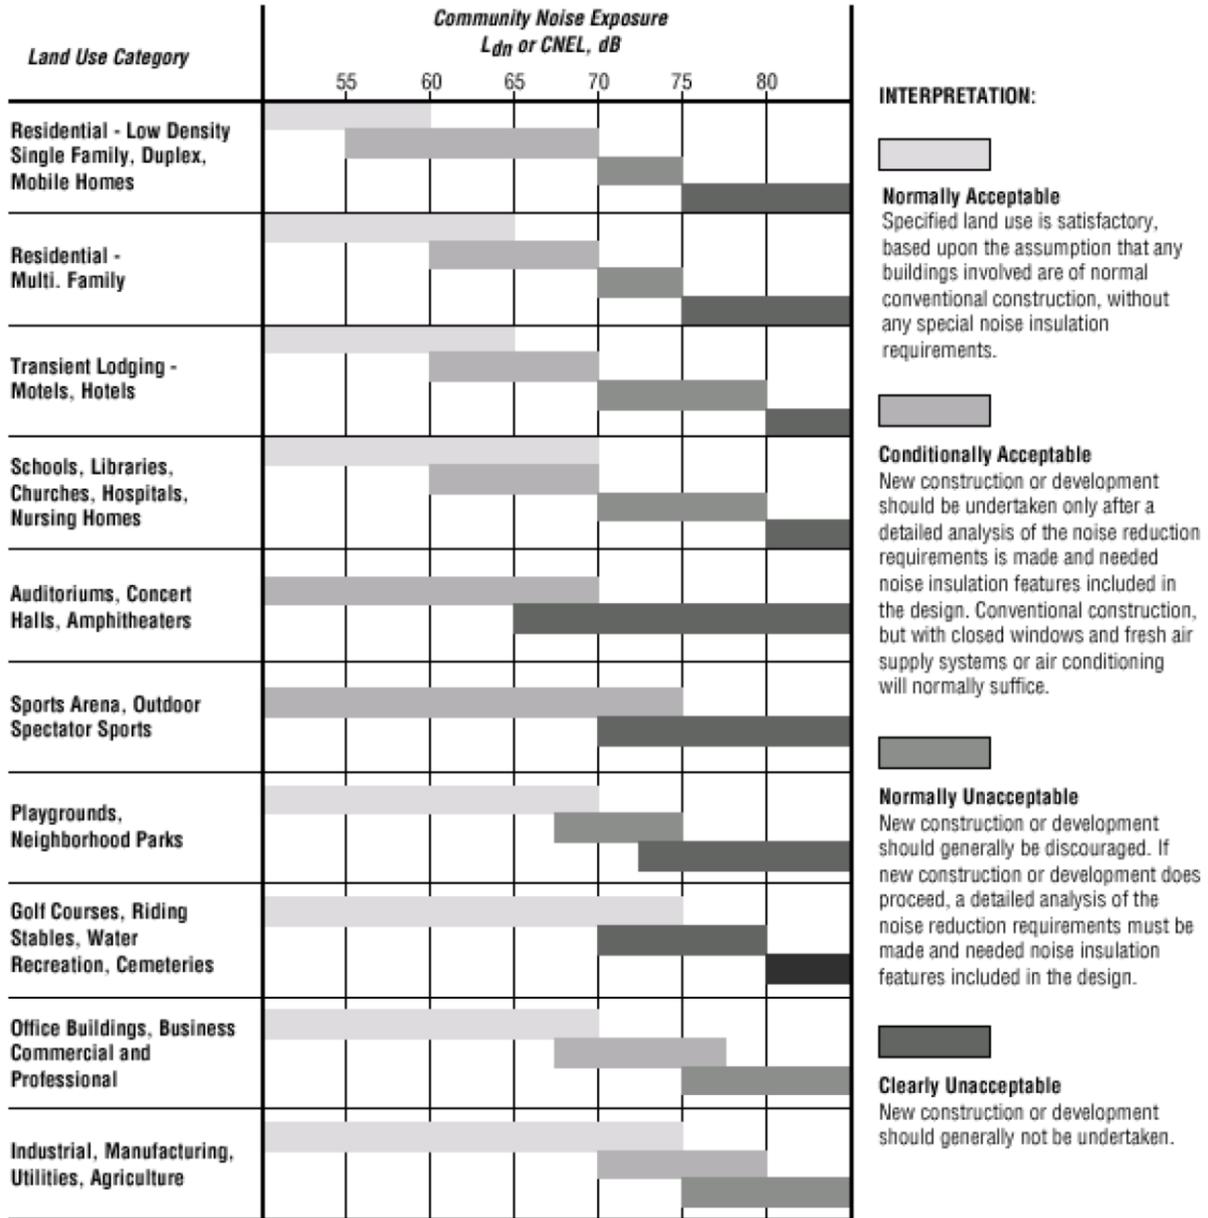

Source: OPR General Plan Guidelines, Appendix D: Noise Element Guidelines, Figure 2.

For normally unacceptable land use, new construction or development should generally be discouraged. If new construction or development does proceed, a detailed analysis of the noise reduction requirements must be made and needed noise insulation features included in the design. (9) For the purposes of this analysis, industrial land use such as the Project does not contain outdoor living areas requiring exterior noise mitigation as outlined in the OPR General Plan Guidelines, and therefore, only the interior noise levels experienced by employees at the Project site are evaluated against the appropriate noise level standards.

The purpose of the transportation noise criteria is to protect, create, and maintain an environment free from noise and vibration that may jeopardize the health or welfare of sensitive receptors, or degrade quality of life. City General Policies (City of Moreno Valley General Plan, pp.9-31, 9-32) act to ensure that when exterior noise levels exceed 65 dBA CNEL at sensitive receivers, mitigation is provided to ensure that interior noise levels of 45 dBA CNEL are maintained. General Plan Policies in this regard are consistent with, and support, the California Building Code interior noise standards.

### 3.3 OPERATIONAL NOISE STANDARDS

To analyze noise impacts originating from a designated fixed location or private property such as the Bay & Day Commerce Center Project, stationary-source (operational) noise such as the expected loading dock activity, roof-top air conditioning units, trash enclosure activity, parking lot vehicle movements, and truck movements are typically evaluated against standards established under a City's Municipal Code.

The City of Moreno Valley Municipal Code, Chapter 11.80 *Noise Regulation*, provides performance standards and noise control guidelines for determining and mitigating non-transportation or stationary-source noise impacts from operations at private properties. The City of Moreno Valley Municipal Code defines *Maximum Sound Levels (in dB(A)) for Source Land Uses* in Table 11.80.030-2 for *Residential* and *Commercial* land uses. As defined by the Municipal Code, Section 11.80.020 *Definitions*, *Commercial* land use means all uses of land not otherwise classified as residential, and *Residential* land use means all uses of land primarily for dwelling units, as well as hospitals, schools, colleges and universities, and places of religious assembly. (11) For the purpose of this analysis, the Bay & Day Commerce Center Project is considered *Commercial* land use since it is not classified as residential. Based on this standard, the operational noise level limits for commercial land use, from Table 11.80.030-2, of 65 dBA  $L_{eq}$  during the daytime (8:00 a.m. to 10:00 p.m.) hours and 60 dBA  $L_{eq}$  during the nighttime (10:01 p.m. to 7:59 a.m.) hours shall apply to the operational noise source activities from the Project.

Further, Section 11.80.030[C] *Prohibited Acts, Nonimpulsive Sound Decibel Limits*, states: *No person shall maintain, create, operate or cause to be operated on private property any source of sound in such a manner as to create any nonimpulsive sound which exceeds the limits set forth for the source land use category (as defined in Section 11.80.020) in Table 11.80.030-2 when measured at a distance of two hundred (200) feet or more from the real property line of the source of the sound, if the sound occurs on a privately owned property...* (11) Therefore, at a distance of 200 feet from the property line, the Project's operational noise levels shall not exceed the 65 dBA  $L_{eq}$  daytime and 60 dBA  $L_{eq}$  nighttime noise level standards for commercial land uses, as shown on Table 3-1.

The City of Moreno Valley Municipal Code also identifies continuous sound level limits in Table 11.80.030-1 based on the Center for Disease Control and Prevention and the National Institute for Occupational Safety and Health (NIOSH) noise exposure guidelines. A division of the U.S. Department of Health and Human Services, NIOSH identifies a noise level threshold based on the duration of exposure to the source. The City of Moreno Valley noise level threshold starts at 90 dBA for more than eight hours per day, and for every increase, the exposure time is reduced. The

City of Moreno Valley identifies noise level thresholds of 92 dBA for more than 6 hours per day, 95 dBA for more than 4 hour per day, 97 dBA for more than 3 hours per day, and up to 100 dBA for more than 2 hours per day. However, this noise study uses the more restrictive City of Moreno Valley commercial noise level limits identified on Table 11.80.030-2 for source land uses in the Municipal Code, shown on Table 3-1 of this report, to evaluate the potential operational noise levels due to the operation of the Project.

**TABLE 3-1: OPERATIONAL NOISE STANDARDS AT 200 FEET FROM THE SOURCE**

City	Source Land use	Noise Level Standards (dBA Leq) <sup>1</sup>	
		Daytime	Nighttime
Moreno Valley	Commercial	65	60

<sup>1</sup> City of Moreno Valley Municipal Code, Chapter 11.80 Noise Regulation, Table 11.80.030-2 Maximum Sound Levels (in dB(A)) for Source Land Uses when measured at a distance of 200 feet from the property line of the source land use (Appendix 3.1). Leq represents a steady state sound level containing the same total energy as a time varying signal over a given period. "Daytime" = 8:00 a.m. to 10:00 p.m.; "Nighttime" = 10:01 p.m. to 7:59 a.m.

### 3.4 CONSTRUCTION NOISE STANDARDS

To analyze noise impacts originating from the construction of the Bay & Day Commerce Center site, noise from construction activities is typically evaluated against standards established under a City’s Municipal Code. The Municipal Code noise standards for construction are described below for the City of Moreno Valley to determine the potential noise impacts at the nearest receiver locations. The construction-related noise standards are shown on Table 3-2.

The Municipal Code noise standards for construction are described below for the City of Moreno Valley to determine the potential noise impacts at the nearest sensitive receiver locations. As a subset of its stationary-source noise regulations, the City Municipal Code establishes permitted hours of construction activity. More specifically, Municipal Code Section 11.80.030[D][7], *Construction and Demolition*, provides the following:

*No person shall operate, or cause operation of any tools or equipment used in construction, drilling, repair, alteration, or demolition work between the hours of eight p.m. and seven a.m. the following day such that the sound there from creates a noise disturbance, except for emergency work by public service utilities or for other work approved by the city manager or designee.*

Therefore, based on Section 11.80.030[D][7] construction regulations, a construction-related *noise disturbance* occurs if Project construction activity occurs outside of the permitted hours. However, for this analysis, the stationary-source noise level limits at 200 feet from the source of 65 dBA Leq during the daytime hours and 60 dBA Leq during the nighttime hours are used as appropriate thresholds for the nearest sensitive land uses (e.g., residential homes) in the Project study area. In addition, grading operations shall be limited to the hours identified in Section 8.21.050[O] of 7:00 a.m. to 6:00 p.m., Monday through Friday, and 8:00 a.m. to 4:00 p.m. on weekends and holidays or as approved by the City Engineer. The City of Moreno Valley construction noise standards are shown on Table 3-2 and included in Appendix 3.1. As previously discussed in Section 3.4, the construction noise level threshold used in this noise study represents

a conservative approach, since it is more restrictive than the continuous sound level limits of Table 11.80.030-1 of the City of Moreno Valley Municipal Code.

**TABLE 3-2: CONSTRUCTION NOISE STANDARDS AT 200 FEET FROM THE SOURCE**

City	Permitted Hours of Construction Activity	Construction Noise Level Standard (dBA Leq) <sup>2</sup>	
		Daytime	Nighttime
Moreno Valley <sup>1</sup>	General Activity: 7:00 a.m. to 8:00 p.m. on any day. Grading is limited to 7:00 a.m. to 6:00 p.m. Monday to Friday; 8:00 a.m. to 4:00 p.m. on weekends and holidays.	65	60 <sup>3</sup>

<sup>1</sup> City of Moreno Valley Municipal Code, Section 11.80.030[D][7] as shown in Appendix 3.1.

<sup>2</sup> Acceptable threshold for determining the relative significance of short-term Project construction noise levels, based on the City of Moreno Valley stationary noise standards shown on Table 3-1.

<sup>3</sup> Any nighttime construction activity requires an exemption from the City of Moreno Valley Municipal Code as indicated in Section 11.80.030 [E][8] for a special event permit (Section 11.80.040). The special event permit application shall be submitted to the City of Moreno Valley Planning Department for approval and meet the requirements of Municipal Code Section 11.80.040.

"Daytime" = 8:00 a.m. to 10:00 p.m.; "Nighttime" = 10:01 p.m. to 7:59 a.m.

To ensure the construction noise level at the nearest noise sensitive receivers located less than 200 feet from the Project, a reasonable daytime exterior construction noise level of 80 dBA Leq and 70 dBA Leq nighttime thresholds are derived from the Federal Transit Administration (FTA) *Transit Noise and Vibration Impact Assessment Manual*. According to the FTA, local noise ordinances are typically not very useful in evaluating construction noise. They usually relate to nuisance and hours of allowed activity, and sometimes specify limits in terms of maximum levels, but are generally not practical for assessing the impact of a construction project. Project construction noise criteria should account for the existing noise environment, the absolute noise levels during construction activities, the duration of the construction, and the adjacent land use. Due to the lack of standardized construction noise thresholds, the FTA provides guidelines that can be considered reasonable criteria for construction noise assessment. (8 p. 179)

### 3.5 VIBRATION STANDARDS

Construction activity can result in varying degrees of ground-borne vibration, depending on the equipment and methods used, distance to the affected structures and soil type. Construction vibration is generally associated with pile driving and rock blasting. Other construction equipment such as air compressors, light trucks, hydraulic loaders, etc., generates little or no ground vibration. (8)


To analyze vibration impacts originating from the operation and construction of the Bay & Day Commerce Center, vibration-generating activities are appropriately evaluated against standards established under a City’s Municipal Code, if such standards exist. However, the City of Moreno Valley does not identify specific vibration level limits. Therefore, for analysis purposes, the Caltrans *Transportation and Construction Vibration Guidance Manual*, (13 p. 38) Table 19, vibration damage are used in this noise study to assess potential temporary construction-related impacts at adjacent building locations. The nearest noise sensitive buildings adjacent to the

Project site can best be described as “older residential structures” with a maximum acceptable continuous vibration threshold of 0.3 PPV (in/sec).

### **3.6 MARCH AIR RESERVE BASE/INLAND PORT AIRPORT LAND USE COMPATIBILITY**

The March Air Reserve Base/Inland Port Airport (MARB/IPA) is located approximately 0.6-miles south of the Project site. The *March Air Reserve Base/Inland Port Airport Land Use Compatibility Plan* (MARB/IPA LUCP) includes the policies for determining the land use compatibility of the Project. The MARB/IPA, Map MA-1, indicates that the Project site is located within Compatibility Zone C1, which Table MA-1 Compatibility Zone Factors indicates is considered to have a *moderate to high* noise impact. (14) Further, the Project site is located outside of the 60 dBA CNEL noise level contour boundary. The MARB/IPA LUCP does not identify industrial-use specific noise compatibility standards, and therefore, the City of Moreno Valley *Land Use Compatibility for Community Noise Exposure* matrix, previously discussed in Section 3.2, is used to assess potential aircraft-related noise levels at the Project site. The City of Moreno Valley guidelines indicate that industrial uses, such as the Project, are considered *normally acceptable* with exterior noise levels of up to 70 dBA CNEL. (10) The noise contour boundaries of MARB/IPA are presented on Exhibit 3-B of this report and show that the Project is considered *normally acceptable* land use since it is located outside of the 60 dBA CNEL contour boundary.

**EXHIBIT 3-B: FUTURE AIRPORT NOISE LEVEL CONTOURS**

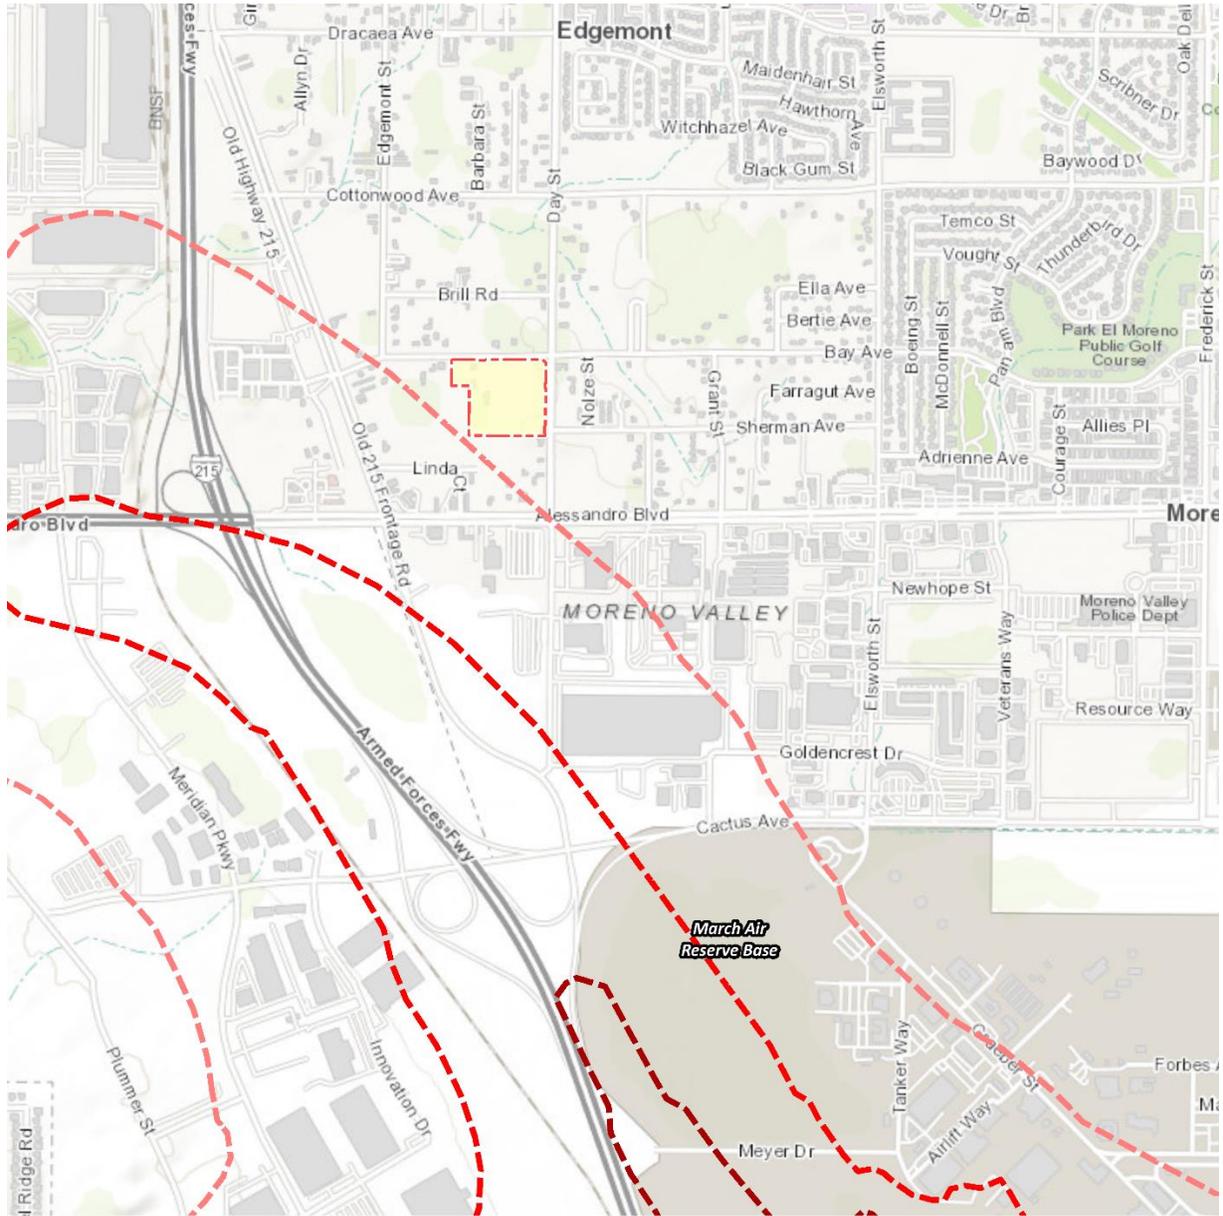

**LEGEND:**

- Site Boundary
- 60 dBA CNEL
- 65 dBA CNEL
- 70 dBA CNEL

Source: Figure 6-9 of the March Air Reserve Base 2018 Final Air Installations Compatible Uses Zones Study.

*This page intentionally left blank*

## 4 SIGNIFICANCE CRITERIA

The following significance criteria are based on currently adopted guidance provided by Appendix G of the California Environmental Quality Act (CEQA) Guidelines. (1) For the purposes of this report, impacts would be potentially significant if the Project results in or causes:

- A. Generation of a substantial temporary or permanent increase in ambient noise levels in the vicinity of the project in excess of standards established in the local general plan or noise ordinance, or applicable standards of other agencies?
- B. Generation of excessive ground-borne vibration or ground-borne noise levels?
- C. For a project located within the vicinity of a private airstrip or an airport land use plan or, where such a plan has not been adopted, within two miles of a public airport or public use airport, would the project expose people residing or working in the project area to excessive noise levels?

### 4.1 NOISE LEVEL INCREASES (THRESHOLD A)

Noise level increases resulting from the Project are evaluated based on the Appendix G CEQA Guidelines described above at the closest sensitive receiver locations. Under CEQA, consideration must be given to the magnitude of the increase, the existing baseline ambient noise levels, and the location of noise-sensitive receivers to determine if a noise increase represents a significant adverse environmental impact. This approach recognizes *that there is no single noise increase that renders the noise impact significant*. (15) This is primarily because of the wide variation in individual thresholds of annoyance and differing individual experiences with noise. Thus, an important way of determining a person's subjective reaction to a new noise is the comparison of it to the existing environment to which one has adapted—the so-called *ambient* environment. In general, the more a new noise exceeds the previously existing ambient noise level, the less acceptable the new noise will typically be judged.

The Federal Interagency Committee on Noise (FICON) (16) developed guidance to be used for the assessment of project-generated increases in noise levels that consider the ambient noise level. The FICON recommendations are based on studies that relate aircraft noise levels to the percentage of persons highly annoyed by aircraft noise. Although the FICON recommendations were specifically developed to assess aircraft noise impacts, these recommendations are often used in environmental noise impact assessments involving the use of cumulative noise exposure metrics, such as the average-daily noise level (CNEL) and equivalent continuous noise level ( $L_{eq}$ ).

As previously stated, the approach used in this noise study recognizes *that there is no single noise increase that renders the noise impact significant*, based on a 2008 California Court of Appeal ruling on *Gray v. County of Madera*. (15) For example, if the ambient noise environment is quiet (<60 dBA) and the new noise source greatly increases the noise levels, an impact may occur if the noise criteria may be exceeded. Therefore, for this analysis, a *readily perceptible* 5 dBA or greater project-related noise level increase is considered a significant impact when the without project noise levels are below 60 dBA. Per the FICON, in areas where the without project noise levels range from 60 to 65 dBA, a 3 dBA *barely perceptible* noise level increase appears to be appropriate for most people. When the without project noise levels already exceed 65 dBA, any

increase in community noise louder than 1.5 dBA or greater is considered a significant impact if the noise criteria for a given land use is exceeded, since it likely contributes to an existing noise exposure exceedance. The FICON guidance provides an established source of criteria to assess the impacts of substantial temporary or permanent increase in baseline ambient noise levels. Based on the FICON criteria, the amount to which a given noise level increase is considered acceptable is reduced when the without Project (baseline) noise levels are already shown to exceed certain land-use specific exterior noise level criteria. The specific levels are based on typical responses to noise level increases of 5 dBA or *readily perceptible*, 3 dBA or *barely perceptible*, and 1.5 dBA depending on the underlying without Project noise levels for noise-sensitive uses. These levels of increases and their perceived acceptance are consistent with the guidance provided by both the Federal Highway Administration (4 p. 9) and Caltrans (17 p. 2\_48).

#### **4.2 VIBRATION (THRESHOLD B)**

As described in Section 3.5, the vibration impacts originating from the construction of Bay & Day Commerce Center, vibration-generating activities are appropriately evaluated using the Caltrans vibration damage thresholds to assess potential temporary construction-related impacts at adjacent building locations. The nearest noise sensitive buildings adjacent to the Project site can best be described as “older residential structures” with a maximum acceptable continuous vibration threshold of 0.3 PPV (in/sec).

#### **4.3 CEQA GUIDELINES NOT FURTHER ANALYZED (THRESHOLD C)**

The closest airport which would require additional noise analysis under CEQA Appendix G Guideline C is the MARB/IPA. As previously described in Section 3.6, the Project is in Compatibility Zone C1, and the Table MA-1 Compatibility Zone Factors indicate that this area is considered to have a *moderate to high* noise impact. In addition, Table MA-2 indicates that the Project land use satisfies the basic compatibility criteria. The noise contour boundaries of MARB/IPA presented on Exhibit 3-B of this report show that the Project is considered *normally acceptable* land use since it is located outside of the 60 dBA CNEL contour boundary. Therefore, the potential impacts under CEQA Appendix G Guideline C, are *less than significant* and are not further analyzed in this noise study.

### 4.3 SIGNIFICANCE CRITERIA SUMMARY

Noise impacts shall be considered significant if any of the following occur as a direct result of the proposed development. Table 4-1 shows the significance criteria summary matrix.

**TABLE 4-1: SIGNIFICANCE CRITERIA SUMMARY**

Analysis	Receiving Land Use	Condition(s)	Significance Criteria	
			Daytime	Nighttime
Operational	Noise-Sensitive	At 200' from the property line of the source <sup>2</sup>	65 dBA Leq	60 dBA Leq
		if ambient is < 60 dBA Leq <sup>1</sup>	≥ 5 dBA Leq Project increase	
		if ambient is 60 - 65 dBA Leq <sup>1</sup>	≥ 3 dBA Leq Project increase	
		if ambient is > 65 dBA Leq <sup>1</sup>	≥ 1.5 dBA Leq Project increase	
Construction	Noise-Sensitive	At 200' from the property line of the source <sup>2</sup>	65 dBA Leq	60 dBA Leq
		Noise Level Threshold <sup>3</sup>	80 dBA Leq	70 dBA Leq
		Vibration Level Threshold <sup>4</sup>	0.3 PPV (in/sec)	

<sup>1</sup> FICON, 1992.

<sup>2</sup> City of Moreno Valley Municipal Code, Chapter 11.80 Noise Regulation (Appendix 3.1).

<sup>3</sup> Caltrans Transportation and Construction Vibration Manual, April 2020 Table 19.

<sup>4</sup> Federal Transit Administration, Transit Noise and Vibration Impact Assessment Manual.  
 "Daytime" = 8:00 a.m. - 10:00 p.m.; "Nighttime" = 10:01 p.m. - 7:59 a.m.

*This page intentionally left blank*

## 5 EXISTING NOISE LEVEL MEASUREMENTS

To assess the existing noise level environment, 24-hour noise level measurements were taken at four locations in the Project study area. The receiver locations were selected to describe and document the existing noise environment within the Project study area. Exhibit 5-A provides the boundaries of the Project study area and the noise level measurement locations. To fully describe the existing noise conditions, noise level measurements were collected by Urban Crossroads, Inc. on Wednesday, June 30<sup>th</sup>, 2021. Appendix 5.1 includes study area photos.

### 5.1 MEASUREMENT PROCEDURE AND CRITERIA

To describe the existing noise environment, the hourly noise levels were measured during typical weekday conditions over a 24-hour period. By collecting individual hourly noise level measurements, it is possible to describe the daytime and nighttime hourly noise levels and calculate the 24-hour CNEL. The long-term noise readings were recorded using Piccolo Type 2 integrating sound level meter and dataloggers. The Piccolo sound level meters were calibrated using a Larson-Davis calibrator, Model CAL 150. All noise meters were programmed in “slow” mode to record noise levels in “A” weighted form. The sound level meters and microphones were equipped with a windscreen during all measurements. All noise level measurement equipment satisfies the American National Standards Institute (ANSI) standard specifications for sound level meters ANSI S1.4-2014/IEC 61672-1:2013. (18)

### 5.2 NOISE MEASUREMENT LOCATIONS

The long-term noise level measurements were positioned as close to the nearest sensitive receiver locations as possible to assess the existing ambient hourly noise levels surrounding the Project site. Both Caltrans and the FTA recognize that it is not reasonable to collect noise level measurements that can fully represent every part of a private yard, patio, deck, or balcony normally used for human activity when estimating impacts for new development projects. This is demonstrated in the Caltrans general site location guidelines which indicate that *sites must be free of noise contamination by sources other than sources of interest. Avoid sites located near sources such as barking dogs, lawnmowers, pool pumps, and air conditioners unless it is the express intent of the analyst to measure these sources.* (2) Further, FTA guidance states, *that it is not necessary nor recommended that existing noise exposure be determined by measuring at every noise-sensitive location in the project area. Rather, the recommended approach is to characterize the noise environment for clusters of sites based on measurements or estimates at representative locations in the community.* (8)

Based on recommendations of Caltrans and the FTA, it is not necessary to collect measurements at each individual building or residence, because each receiver measurement represents a group of buildings that share acoustical equivalence. (8) In other words, the area represented by the receiver shares similar shielding, terrain, and geometric relationship to the reference noise source. Receivers represent a location of noise sensitive areas and are used to estimate the future noise level impacts. Collecting reference ambient noise level measurements at the nearest sensitive receiver locations allows for a comparison of the before and after Project noise levels

and is necessary to assess potential noise impacts due to the Project’s contribution to the ambient noise levels.

### 5.3 NOISE MEASUREMENT RESULTS

The noise measurements presented below focus on the average or equivalent sound levels ( $L_{eq}$ ). The equivalent sound level ( $L_{eq}$ ) represents a steady state sound level containing the same total energy as a time varying signal over a given sample period. Table 5-1 identifies the hourly daytime (8:00 a.m. to 10:00 p.m.) and nighttime (10:00 p.m. to 8:00 a.m.) noise levels at each noise level measurement location.

**TABLE 5-1: 24-HOUR AMBIENT NOISE LEVEL MEASUREMENTS**

Location <sup>1</sup>	Description	Energy Average Noise Level (dBA $L_{eq}$ ) <sup>2</sup>	
		Daytime	Nighttime
L1	Located within Project site on Bay Avenue near single-family residence at 21891 Bay Avenue.	50.9	50.0
L2	Located north of the Project site on Bay Avenue near single-family residence at 21948 Bay Avenue.	61.4	59.4
L3	Located at the eastern Project site boundary on Day Street.	53.4	49.8
L4	Located at the southern Project site boundary on Day Street near single-family residence at 13881 Day Street.	53.8	50.2

<sup>1</sup> See Exhibit 5-A for the noise level measurement locations.


<sup>2</sup> Energy (logarithmic) average levels. The long-term 24-hour measurement worksheets are included in Appendix 5.2.

"Daytime" = 8:00 a.m. to 10:00 p.m.; "Nighttime" = 10:00 p.m. to 8:00 a.m.

Table 5-1 provides the (energy average) noise levels used to describe the daytime and nighttime ambient conditions. These daytime and nighttime energy average noise levels represent the average of all hourly noise levels observed during these time periods expressed as a single number. Appendix 5.2 provides summary worksheets of the noise levels for each hour as well as the minimum, maximum,  $L_1$ ,  $L_2$ ,  $L_5$ ,  $L_8$ ,  $L_{25}$ ,  $L_{50}$ ,  $L_{90}$ ,  $L_{95}$ , and  $L_{99}$  percentile noise levels observed during the daytime and nighttime periods.

The background ambient noise levels in the Project study area are dominated by the transportation-related noise associated with surface streets. This includes the auto and heavy truck activities on study area roadway segments near the noise level measurement locations.

EXHIBIT 5-A: NOISE MEASUREMENT LOCATIONS

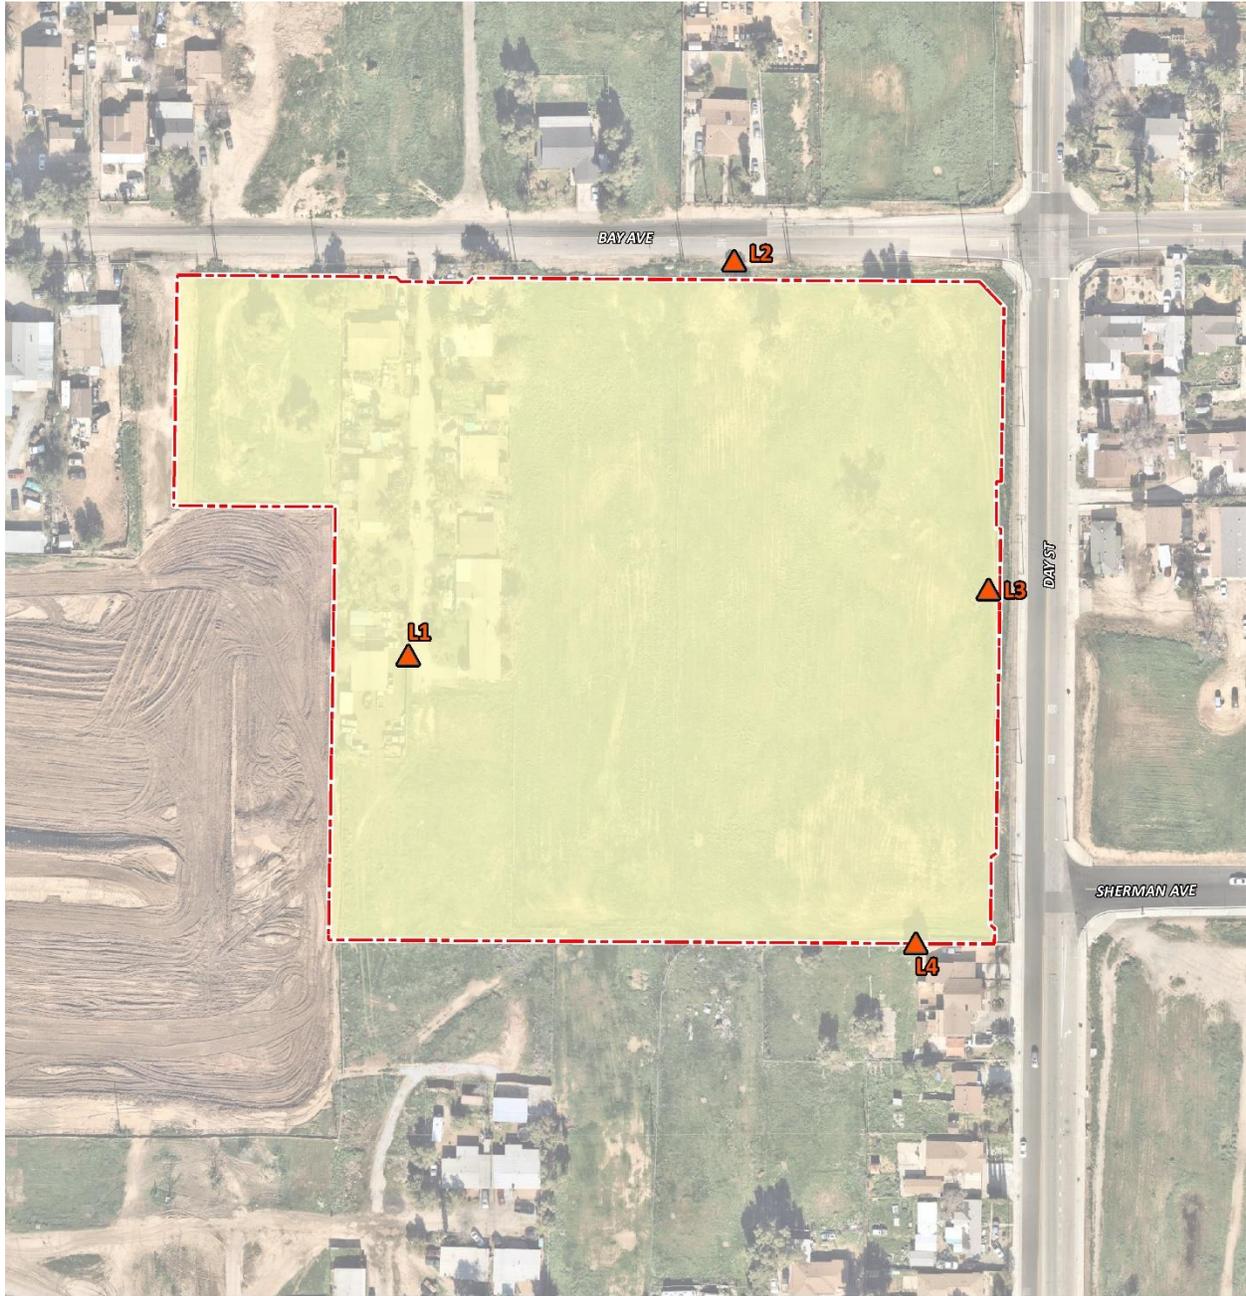

**LEGEND:**  
N   Site Boundary  Measurement Locations

*This page intentionally left blank*

## 6 SENSITIVE RECEIVER LOCATIONS


To assess the potential for long-term operational and short-term construction noise impacts, the following sensitive receiver locations, as shown on Exhibit 6-A, were identified as representative locations for analysis. Sensitive receivers are generally defined as locations where people reside or where the presence of unwanted sound could otherwise adversely affect the use of the land. Noise-sensitive land uses are generally considered to include schools, hospitals, single-family dwellings, mobile home parks, churches, libraries, and recreation areas. Moderately noise-sensitive land uses typically include multi-family dwellings, hotels, motels, dormitories, outpatient clinics, cemeteries, golf courses, country clubs, athletic/tennis clubs, and equestrian clubs. Land uses that are considered relatively insensitive to noise include business, commercial, and professional developments. Land uses that are typically not affected by noise include: industrial, manufacturing, utilities, agriculture, undeveloped land, parking lots, warehousing, liquid and solid waste facilities, salvage yards, and transit terminals.

To describe the potential off-site Project noise levels, six receiver locations in the vicinity of the Project site were identified. All distances are measured from the Project site boundary to the outdoor living areas (e.g., private backyards) or at the building façade, whichever is closer to the Project site. The selection of receiver locations is based on FHWA guidelines and is consistent with additional guidance provided by Caltrans and the FTA, as previously described in Section 5.2. Other sensitive land uses in the Project study area that are located at greater distances than those identified in this noise study will experience lower noise levels than those presented in this report due to the additional attenuation from distance and the shielding of intervening structures. Distance is measured in a straight line from the project boundary to each receiver location.

- R1: Location R1 represents the existing noise sensitive residence at 21918 Bay Avenue, approximately 96 feet north of the Project site. Since there are no private outdoor living areas (backyards) facing the Project site, receiver R1 is placed at the residential building façade. A 24-hour noise measurement was taken near this location, L2, to describe the existing ambient noise environment.
- R2: Location R2 represents the existing noise sensitive residence at 13808 Day Street, approximately 88 feet east of the Project site. Since there are no private outdoor living areas (backyards) facing the Project site, receiver R2 is placed at the residential building façade. A 24-hour noise measurement near this location, L3, is used to describe the existing ambient noise environment.
- R3: Location R3 represents the existing noise sensitive residence at 13881 Day Street, approximately 20 feet south of the Project site. R3 is placed in the private outdoor living areas (backyard) facing the Project site. A 24-hour noise measurement near this location, L4, is used to describe the existing ambient noise environment.
- R4: Location R4 represents the existing noise sensitive residence at 21892 Linda Court, approximately 195 feet south of the Project site. R4 is placed in the private outdoor living areas (backyard) facing the Project site. A 24-hour noise measurement was taken near this location, L1, to describe the existing ambient noise environment.

R5: Location R5 represents the existing noise sensitive residence at 21850 Bay Avenue, approximately 82 feet north of the Project site. Since there are no private outdoor living areas (backyards) facing the Project site, receiver R5 is placed at the residential building façade. A 24-hour noise measurement, L2, is used to describe the existing ambient noise environment.

**EXHIBIT 6-A: SENSITIVE RECEIVER LOCATIONS**

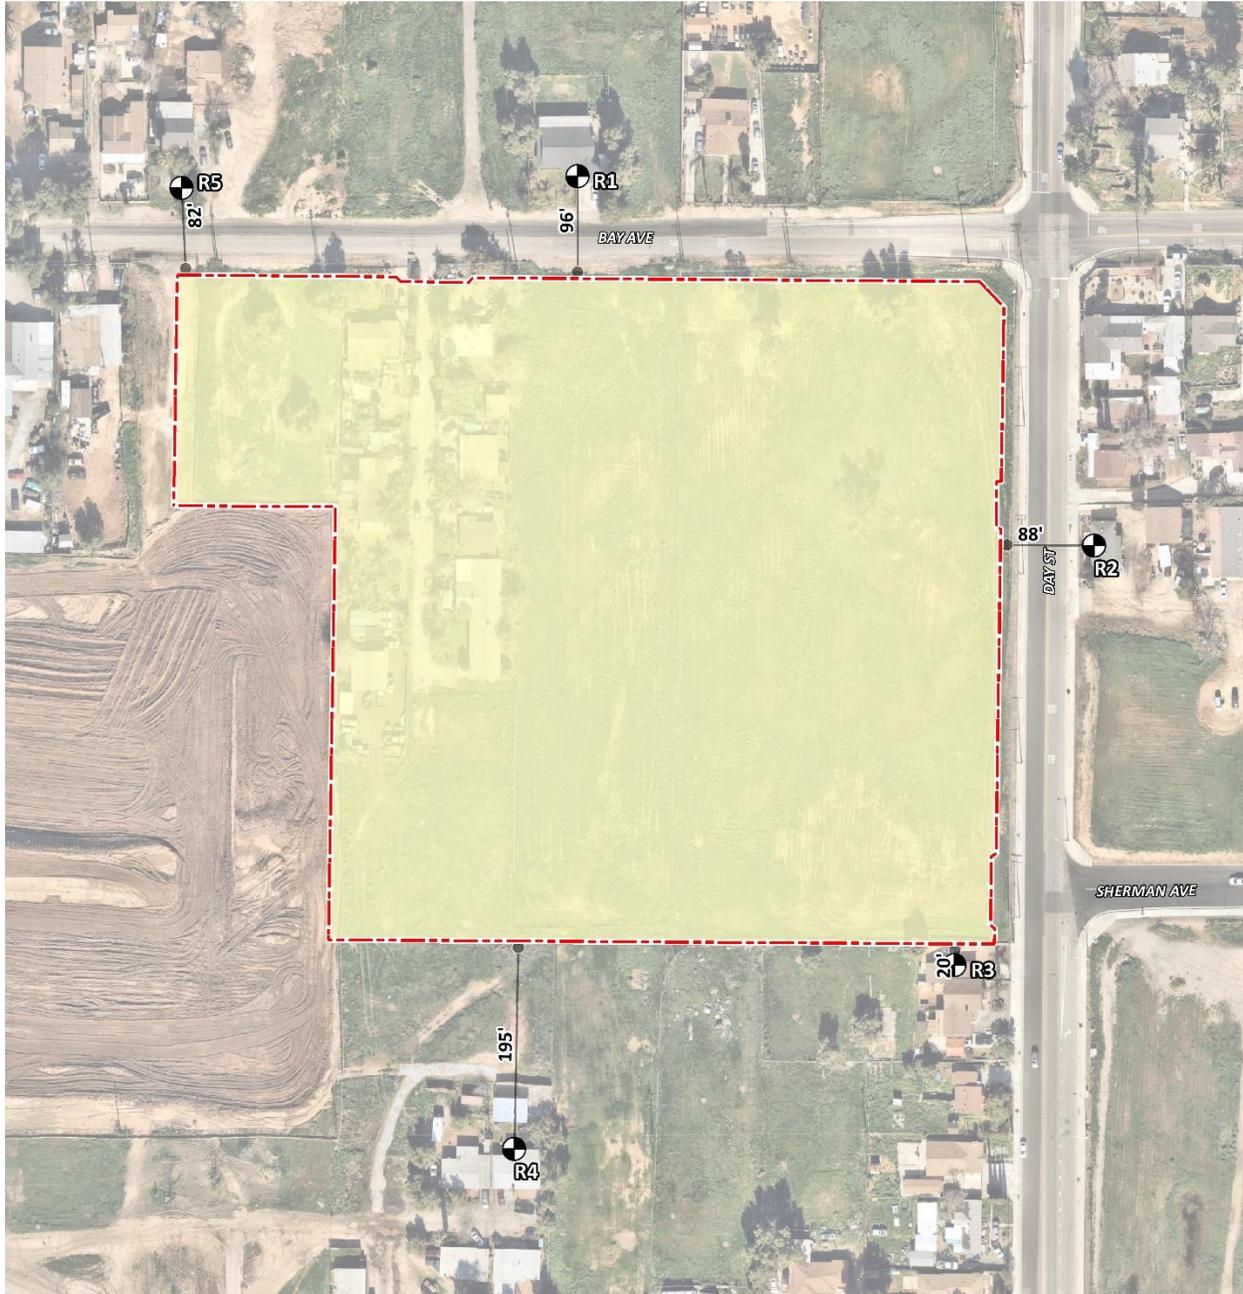

## 7 OPERATIONAL NOISE IMPACTS

This section analyzes the potential stationary-source operational noise impacts at the nearest receiver locations, identified in Section 6, resulting from the operation of the proposed Bay & Day Commerce Center Project. Exhibit 7-A identifies the representative noise source locations used to assess the operational noise levels. The operational noise analysis includes the planned 10 to 14-foot-high screen walls on the northern and southern loading dock areas. The screenwall shown on Exhibit 7-A is designed for screening, privacy, noise control, and security.

### 7.1 OPERATIONAL NOISE SOURCES

This operational noise analysis is intended to describe noise level impacts associated with the expected typical of daytime and nighttime activities at the Project site. Consistent with similar warehouse uses, the Project business operations would primarily be conducted within the enclosed buildings, except for traffic movement, parking, as well as loading and unloading of trucks at designated loading bays. The on-site Project-related noise sources are expected to include: loading dock activity, roof-top air conditioning units, trash enclosure activity, parking lot vehicle movements, and truck movements.


### 7.2 REFERENCE NOISE LEVELS

To estimate the Project operational noise impacts, reference noise level measurements were collected from similar types of activities to represent the noise levels expected with the development of the proposed Project. This section provides a detailed description of the reference noise level measurements shown on Table 7-1 used to estimate the Project operational noise impacts. It is important to note that the following projected noise levels assume the worst-case noise environment with the loading dock activity, roof-top air conditioning units, trash enclosure activity, parking lot vehicle movements, and truck movements all operating at the same time. These sources of noise activity will likely vary throughout the day.

#### 7.2.1 MEASUREMENT PROCEDURES

The reference noise level measurements presented in this section were collected using a Larson Davis LxT Type 1 precision sound level meter (serial number 01146). The LxT sound level meter was calibrated using a Larson-Davis calibrator, Model CAL 200, was programmed in "slow" mode to record noise levels in "A" weighted form and was located at approximately five feet above the ground elevation for each measurement. The sound level meters and microphones were equipped with a windscreen during all measurements. All noise level measurement equipment satisfies the American National Standards Institute (ANSI) standard specifications for sound level meters ANSI S1.4-2014/IEC 61672-1:2013. (18)

**EXHIBIT 7-A: OPERATIONAL NOISE SOURCE LOCATIONS**

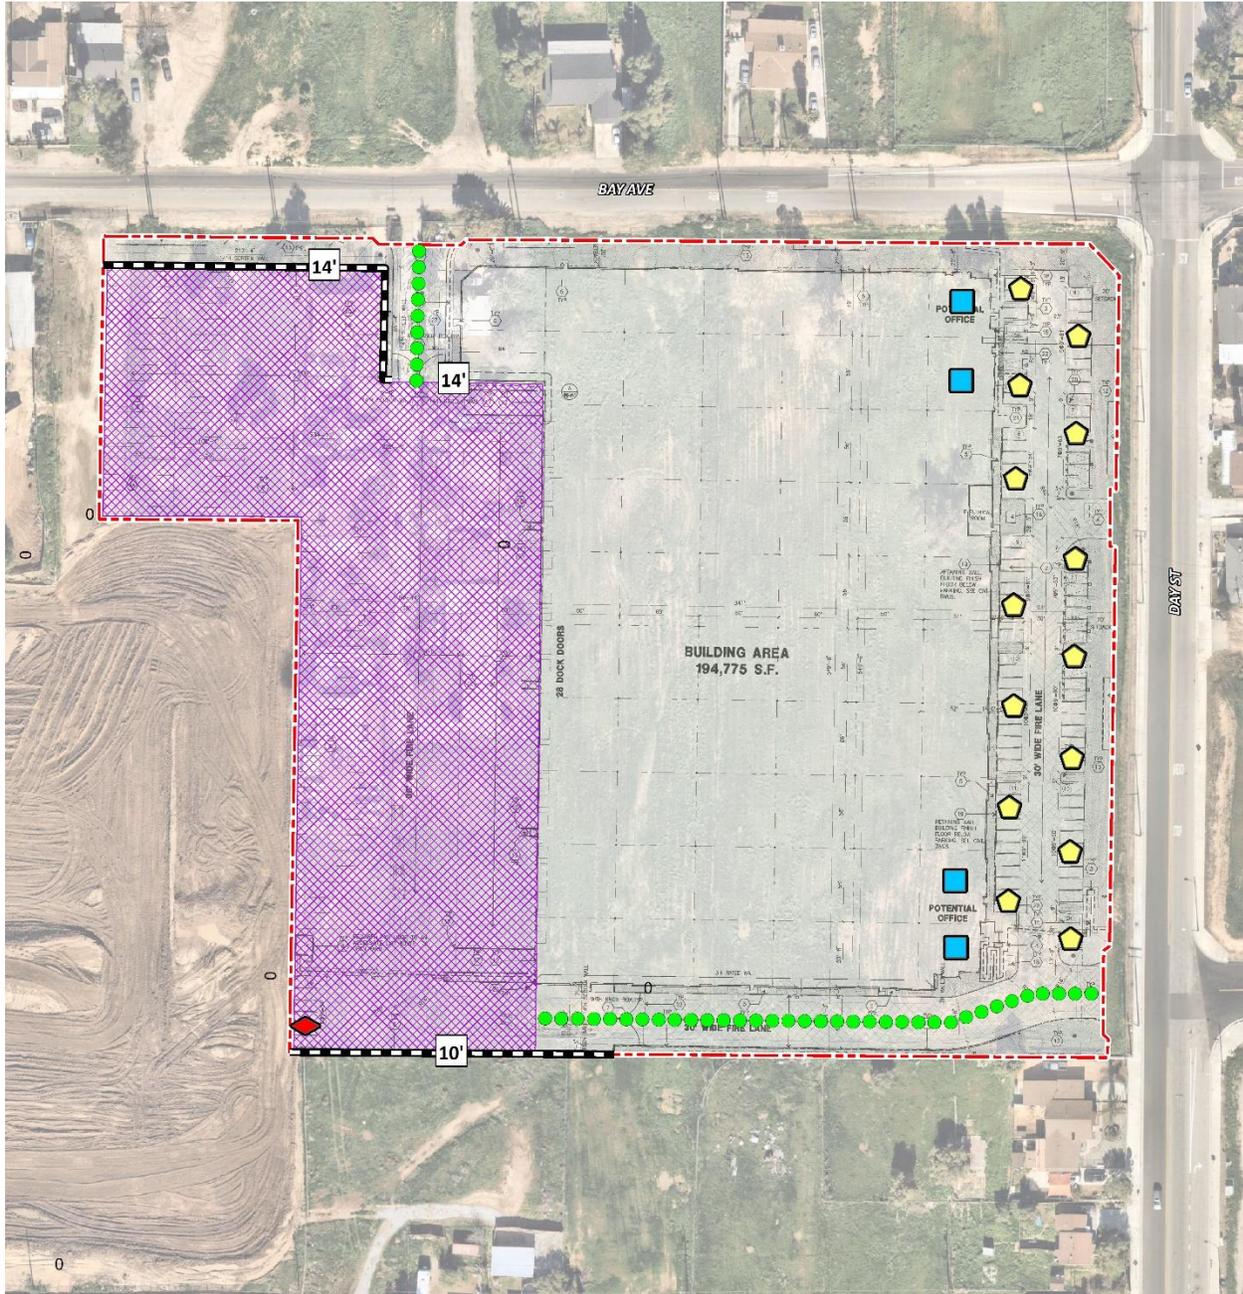

**LEGEND:**

- |                       |                          |                                |                                 |                    |
|-----------------------|--------------------------|--------------------------------|---------------------------------|--------------------|
|                       | Site Boundary            | Roof-Top Air Conditioning Unit | Parking Lot Vehicle Movements   | Planned Screenwall |
| Loading Dock Activity | Trash Enclosure Activity | Truck Movements                | 10' Screenwall Height (in feet) |                    |

**TABLE 7-1: REFERENCE NOISE LEVEL MEASUREMENTS**

Noise Source <sup>1</sup>	Noise Source Height (Feet)	Min./Hour <sup>2</sup>		Reference Noise Level (dBA L <sub>eq</sub> ) @ 50 Feet	Sound Power Level (dBA) <sup>3</sup>
		Day	Night		
Loading Dock Activity	8'	60	60	65.7	111.5
Roof-Top Air Conditioning Units	5'	39	28	57.2	88.9
Trash Enclosure Activity	5'	60	30	57.3	89.0
Parking Lot Vehicle Movements	5'	60	60	56.1	79.0
Truck Movements	8'	60	60	59.8	93.2

<sup>1</sup> As measured by Urban Crossroads, Inc.

<sup>2</sup> Anticipated duration (minutes within the hour) of noise activity during typical hourly conditions expected at the Project site. "Daytime" = 8:00 a.m. - 10:00 p.m.; "Nighttime" = 10:01 p.m. - 7:59 a.m.

<sup>3</sup> Sound power level represents the total amount of acoustical energy (noise level) produced by a sound source independent of distance or surroundings. Sound power levels calculated using the CadnaA noise model at the reference distance to the noise source.

**7.2.2 LOADING DOCK ACTIVITY**

The reference loading dock activities are intended to describe the typical outdoor operational noise activities associated with the Project. This includes truck idling, reefer activity (refrigerator truck/cold storage), deliveries, backup alarms, trailer docking including a combination of tractor trailer semi-trucks, two-axle delivery trucks, and background operation activities. Since the noise levels generated by cold storage loading dock activity can be slightly higher due to the use of refrigerated trucks or reefers, this analysis conservatively assumes that all loading dock activity is associated with cold storage facilities, even though only 25 percent cold storage is anticipated.

The reference noise level measurement was taken in the center of the loading dock activity area and represents multiple concurrent noise sources resulting in a combined noise level of 65.7 dBA L<sub>eq</sub> at a uniform distance of 50 feet. Specifically, the reference noise level measurement represents one truck located approximately 30 feet from the noise level meter with another truck passing by to park roughly 20 feet away, both with their engines idling. Throughout the reference noise level measurement, a separate docked and running reefer truck was located approximately 50 feet east of the measurement location. Additional background noise sources included truck pass-by noise, truck drivers talking to each other next to docked trucks, and air brake release noise when trucks parked.

**7.2.3 ROOF-TOP AIR CONDITIONING UNITS**

The noise level measurements describe a single mechanical roof-top air conditioning unit. The reference noise level represents a Lennox SCA120 series 10-ton model packaged air conditioning unit. At the uniform reference distance of 50 feet, the reference noise level is 57.2 dBA L<sub>eq</sub>. Based on the typical operating conditions observed over a four-day measurement period, the roof-top air conditioning units are estimated to operate for an average 39 minutes per hour during the daytime hours, and 28 minutes per hour during the nighttime hours. These operating conditions reflect peak summer cooling requirements with measured temperatures approaching 96 degrees

Fahrenheit (°F) with average daytime temperatures of 82°F. For this noise analysis, the air conditioning units are expected to be located on the roof of the Project buildings.

#### **7.2.4 TRASH ENCLOSURE ACTIVITY**

To describe the noise levels associated with a trash enclosure activity, Urban Crossroads collected a reference noise level measurement at an existing trash enclosure containing two dumpster bins. The trash enclosure noise levels describe metal gates opening and closing, metal scraping against concrete floor sounds, dumpster movement on metal wheels, and trash dropping into the metal dumpster. The reference noise levels describe trash enclosure noise activities when trash is dropped into an empty metal dumpster, as would occur at the Project Site. The measured reference noise level at the uniform 50-foot reference distance is 57.3 dBA  $L_{eq}$  for the trash enclosure activity. The reference noise level describes the expected noise source activities associated with the trash enclosures for the Project's proposed building.

#### **7.2.5 PARKING LOT VEHICLE MOVEMENTS**

To describe the on-site parking lot activity a reference noise level of 56.1 dBA  $L_{eq}$  at 50 feet is used. Parking activities are expected to take place during the full hour (60 minutes) throughout the daytime and evening hours. The parking lot noise levels are mainly due to cars pulling in and out of parking spaces.

#### **7.2.6 TRUCK MOVEMENTS**

The truck movements reference noise level measurement was collected over a period of 1 hour and 28 minutes and represent multiple heavy trucks entering and exiting the outdoor loading dock area producing a reference noise level of 59.8 dBA  $L_{eq}$  at 50 feet. The noise sources included at this measurement location account for trucks entering and existing the Project driveways and maneuvering in and out of the outdoor loading dock activity area.

### **7.3 CADNA A NOISE PREDICTION MODEL**

To fully describe the exterior operational noise levels from the Project, Urban Crossroads, Inc. developed a noise prediction model using the CadnaA (Computer Aided Noise Abatement) computer program. CadnaA can analyze multiple types of noise sources using the spatially accurate Project site plan, georeferenced Nearmap aerial imagery, topography, buildings, and barriers in its calculations to predict outdoor noise levels.

Using the ISO 9613-2 protocol, CadnaA will calculate the distance from each noise source to the noise receiver locations, using the ground absorption, distance, and barrier/building attenuation inputs to provide a summary of noise level at each receiver and the partial noise level contributions by noise source. Consistent with the ISO 9613-2 protocol, the CadnaA noise prediction model relies on the reference sound power level ( $L_w$ ) to describe individual noise sources. While sound pressure levels (e.g.,  $L_{eq}$ ) quantify in decibels the intensity of given sound sources at a reference distance, sound power levels ( $L_w$ ) are connected to the sound source and are independent of distance. Sound pressure levels vary substantially with distance from the source and diminish because of intervening obstacles and barriers, air absorption, wind, and

other factors. Sound power is the acoustical energy emitted by the sound source and is an absolute value that is not affected by the environment.

The operational noise level calculations provided in this noise study account for the distance attenuation provided due to geometric spreading, when sound from a localized stationary source (i.e., a point source) propagates uniformly outward in a spherical pattern. A default ground attenuation factor of 0.5 was used in the CadnaA noise analysis to account for mixed ground representing a combination of hard and soft surfaces. Appendix 7.1 includes the detailed noise model inputs used to estimate the Project operational noise levels presented in this section.

#### 7.4 PROJECT OPERATIONAL NOISE LEVELS

Using the reference noise levels to represent the proposed Project operations that include loading dock activity, roof-top air conditioning units, trash enclosure activity, parking lot vehicle movements, and truck movements, Urban Crossroads, Inc. calculated the operational source noise levels that are expected to be generated at the Project site and the Project-related noise level increases that would be experienced at each of the sensitive receiver locations and at 200 feet from the property line of the source. Table 7-2 shows the Project operational noise levels during the daytime hours of 8:00 a.m. to 10:00 p.m. The daytime hourly noise levels at the off-site receiver locations are expected to range from 43.3 to 52.6 dBA  $L_{eq}$ .

**TABLE 7-2: DAYTIME PROJECT OPERATIONAL NOISE LEVELS**

Noise Source <sup>1</sup>	Operational Noise Levels by Receiver Location (dBA $L_{eq}$ )					
	R1	R2	R3	R4	R5	at 200'
Loading Dock Activity	47.5	31.3	43.8	52.1	52.3	52.3
Roof-Top Air Conditioning Units	33.6	39.0	42.8	32.5	29.3	30.7
Trash Enclosure Activity	11.3	7.8	28.9	33.4	23.8	35.3
Parking Lot Vehicle Movements	21.9	40.3	40.6	18.1	11.7	16.5
Truck Movements	44.5	31.8	50.6	41.0	37.8	38.5
<b>Total (All Noise Sources)</b>	<b>49.4</b>	<b>43.3</b>	<b>52.3</b>	<b>52.5</b>	<b>52.5</b>	<b>52.6</b>

<sup>1</sup> See Exhibit 7-A for the noise source locations. CadnaA noise model calculations are included in Appendix 7.1.

Table 7-3 shows the Project operational noise levels during the nighttime hours of 10:01 p.m. to 7:59 a.m. The nighttime hourly noise levels at the off-site receiver locations are expected to range from 42.6 to 52.5 dBA  $L_{eq}$ . The differences between the daytime and nighttime noise levels are largely related to the duration of noise activity (Table 7-1).

**TABLE 7-3: NIGHTTIME PROJECT OPERATIONAL NOISE LEVELS**

Noise Source <sup>1</sup>	Operational Noise Levels by Receiver Location (dBA Leq)					
	R1	R2	R3	R4	R5	at 200'
Loading Dock Activity	47.5	31.3	43.8	52.1	52.3	52.3
Roof-Top Air Conditioning Units	31.2	36.6	40.4	30.1	26.9	28.3
Trash Enclosure Activity	7.4	3.8	24.9	29.4	19.8	31.3
Parking Lot Vehicle Movements	21.9	40.3	40.6	18.1	11.7	16.5
Truck Movements	44.5	31.8	50.6	41.0	37.8	38.5
<b>Total (All Noise Sources)</b>	<b>49.3</b>	<b>42.6</b>	<b>52.1</b>	<b>52.5</b>	<b>52.5</b>	<b>52.5</b>

<sup>1</sup> See Exhibit 7-A for the noise source locations. CadnaA noise model calculations are included in Appendix 7.1.

### 7.5 PROJECT OPERATIONAL NOISE LEVEL COMPLIANCE

To demonstrate compliance with local noise regulations, the Project-only operational noise levels are evaluated against exterior noise level thresholds based on the City of Moreno Valley exterior noise level standards at the nearest noise-sensitive receiver locations. Table 7-4 shows the operational noise levels associated with Bay & Day Commerce Center Project will not exceed the City of Moreno Valley 65 dBA Leq daytime and 60 dBA Leq nighttime exterior noise level standards at all the nearest receiver locations and at 200 feet from the property line of the source with the planned 10 to 14-foot-high noise barrier as shown on Exhibit 7-A. Therefore, the operational noise impacts are considered *less than significant* at the nearest noise-sensitive receiver locations.

**TABLE 7-4: OPERATIONAL NOISE LEVEL COMPLIANCE**

Receiver Location <sup>1</sup>	Project Operational Noise Levels (dBA Leq) <sup>2</sup>		Noise Level Standards (dBA Leq) <sup>3</sup>		Noise Level Standards Exceeded? <sup>4</sup>	
	Daytime	Nighttime	Daytime	Nighttime	Daytime	Nighttime
R1	49.4	49.3	65	60	No	No
R2	43.3	42.6	65	60	No	No
R3	52.3	52.1	65	60	No	No
R4	52.5	52.5	65	60	No	No
R5	52.5	52.5	65	60	No	No
at 200'	52.6	52.5	65	60	No	No

<sup>1</sup> See Exhibit 7-A for the receiver locations.

<sup>2</sup> Proposed Project operational noise levels as shown on Tables 7-2 and 7-3.

<sup>3</sup> Exterior noise level standards for source (commercial) land use, as shown on Table 4-1.

<sup>4</sup> Do the estimated Project operational noise source activities exceed the noise level standards?

"Daytime" = 8:00 a.m. - 10:00 p.m.; "Nighttime" = 10:01 p.m. - 7:59 a.m.

## 7.6 PROJECT OPERATIONAL NOISE LEVEL INCREASES

To describe the Project operational noise level increases, the Project operational noise levels are combined with the existing ambient noise levels measurements for the nearest receiver locations potentially impacted by Project operational noise sources. Since the units used to measure noise, decibels (dB), are logarithmic units, the Project-operational and existing ambient noise levels cannot be combined using standard arithmetic equations. (2) Instead, they must be logarithmically added using the following base equation:

$$\text{SPL}_{\text{Total}} = 10\log_{10}[10^{\text{SPL1}/10} + 10^{\text{SPL2}/10} + \dots 10^{\text{SPLn}/10}]$$

Where “SPL1,” “SPL2,” etc. are equal to the sound pressure levels being combined, or in this case, the Project-operational and existing ambient noise levels. The difference between the combined Project and ambient noise levels describes the Project noise level increases to the existing ambient noise environment. As indicated on Table 7-5, the Project will generate a daytime operational noise level increase ranging from 0.3 to 3.9 dBA  $L_{\text{eq}}$  at the nearest receiver locations. Table 7-6 shows that the Project will generate a nighttime operational noise level increase ranging from 0.4 to 4.4 dBA  $L_{\text{eq}}$  at the nearest receiver locations. Project-related operational noise level increases will satisfy the operational noise level increase significance criteria presented in Table 4-1. Therefore, the incremental Project operational noise level increase is considered *less than significant* at all receiver locations.

**TABLE 7-5: DAYTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES**

Receiver Location <sup>1</sup>	Total Project Operational Noise Level <sup>2</sup>	Measurement Location <sup>3</sup>	Reference Ambient Noise Levels <sup>4</sup>	Combined Project and Ambient <sup>5</sup>	Project Increase <sup>6</sup>	Increase Criteria <sup>7</sup>	Increase Criteria Exceeded?
R1	49.4	L2	61.4	61.7	0.3	3.0	No
R2	43.3	L3	53.4	53.8	0.4	5.0	No
R3	52.3	L4	53.8	56.1	2.3	5.0	No
R4	52.5	L1	50.9	54.8	3.9	5.0	No
R5	52.5	L2	61.4	61.9	0.5	3.0	No

<sup>1</sup> See Exhibit 7-A for the receiver locations.  
<sup>2</sup> Total Project daytime operational noise levels as shown on Table 7-5.  
<sup>3</sup> Reference noise level measurement locations as shown on Exhibit 5-A.  
<sup>4</sup> Observed daytime ambient noise levels as shown on Table 5-1.  
<sup>5</sup> Represents the combined ambient conditions plus the Project activities.  
<sup>6</sup> The noise level increase expected with the addition of the proposed Project activities.  
<sup>7</sup> Significance increase criteria as shown on Table 4-1.

**TABLE 7-6: NIGHTTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES**

Receiver Location <sup>1</sup>	Total Project Operational Noise Level <sup>2</sup>	Measurement Location <sup>3</sup>	Reference Ambient Noise Levels <sup>4</sup>	Combined Project and Ambient <sup>5</sup>	Project Increase <sup>6</sup>	Increase Criteria <sup>7</sup>	Increase Criteria Exceeded?
R1	49.3	L2	59.4	59.8	0.4	5.0	No
R2	42.6	L3	49.8	50.6	0.8	5.0	No
R3	52.1	L4	50.2	54.3	4.1	5.0	No
R4	52.5	L1	50.0	54.4	4.4	5.0	No
R5	52.5	L2	59.4	60.2	0.8	5.0	No

<sup>1</sup> See Exhibit 7-A for the receiver locations.  
<sup>2</sup> Total Project nighttime operational noise levels as shown on Table 7-6.  
<sup>3</sup> Reference noise level measurement locations as shown on Exhibit 5-A.  
<sup>4</sup> Observed nighttime ambient noise levels as shown on Table 5-1.  
<sup>5</sup> Represents the combined ambient conditions plus the Project activities.  
<sup>6</sup> The noise level increase expected with the addition of the proposed Project activities.  
<sup>7</sup> Significance increase criteria as shown on Table 4-1.

*This page intentionally left blank*

## 8 CONSTRUCTION IMPACTS

This section analyzes potential impacts resulting from the construction activities associated with the development of the Project. Exhibit 8-A shows the construction noise source activity (building area) in relation to the nearest sensitive receiver locations previously described in Section 6.

To prevent high levels of construction noise from impacting noise-sensitive land uses, City of Moreno Valley Municipal Code Section 11.80.030[D][7] limits general construction activities within 200 feet of residential uses to weekdays, between 7:00 a.m. and 8:00 p.m. In addition, grading operations shall be limited to the hours identified in Section 8.21.050[O] of 7:00 a.m. to 6:00 p.m., Monday through Friday, and 8:00 a.m. to 4:00 p.m. on weekends and holidays or as approved by the City Engineer.

### 8.1 CONSTRUCTION NOISE LEVELS


The FTA *Transit Noise and Vibration Impact Assessment Manual* recognizes that construction projects are accomplished in several different stages and outlines the procedures for assessing noise impacts during construction. Each stage has a specific equipment mix, depending on the work to be completed during that stage. As a result of the equipment mix, each stage has its own noise characteristics; some stages have higher continuous noise levels than others, and some have higher impact noise levels than others. The Project construction activities are expected to occur in the following stages:

- Site Preparation
- Grading
- Building Construction
- Paving
- Architectural Coating

### 8.2 CONSTRUCTION REFERENCE NOISE LEVELS

To describe construction noise activities, this construction noise analysis was prepared using reference construction equipment noise levels from the Federal Highway Administration (FHWA) published the Roadway Construction Noise Model (RCNM), which includes a national database of construction equipment reference noise emission levels. (19) The RCNM equipment database, provides a comprehensive list of the noise generating characteristics for specific types of construction equipment. In addition, the database provides an acoustical usage factor to estimate the fraction of time each piece of construction equipment is operating at full power (i.e., its loudest condition) during a construction operation.

EXHIBIT 8-A: CONSTRUCTION NOISE SOURCE LOCATIONS

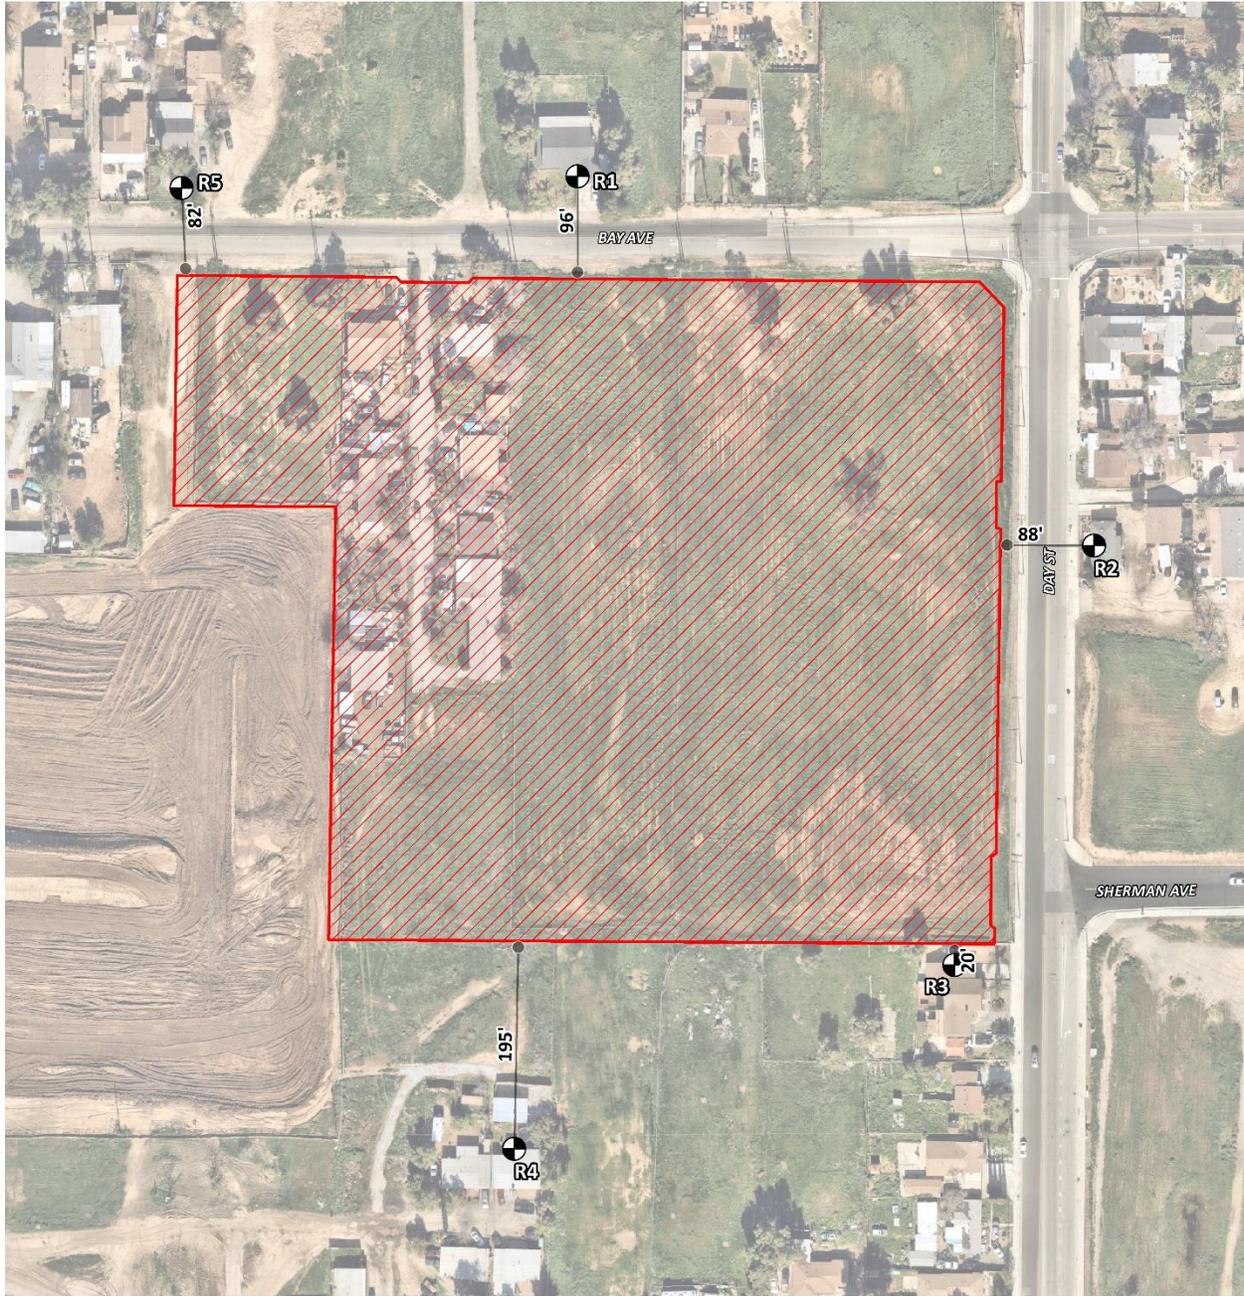

**LEGEND:**  
N  
[Red Hatched Box] Construction Activity    [Black Circle with Dot] Receiver Locations    [Line with Dot] Distance from receiver to Project site boundary (in feet)

### 8.3 CONSTRUCTION NOISE ANALYSIS

Using the reference construction equipment noise levels and the CadnaA noise prediction model, calculations of the Project construction noise level impacts at the nearby sensitive receiver locations were completed. Consistent with FTA guidance for general construction noise assessment, Table 8-1 presents the combined noise levels for the loudest construction equipment, assuming they operate at the same time. As shown on Table 8-2, the construction noise levels are expected to range from 57.6 to 72.6 dBA  $L_{eq}$  at the nearest receiver locations and 63.6 dBA  $L_{eq}$  at 200 feet from the property line of the source. Appendix 8.1 includes the detailed CadnaA construction noise model inputs.

**TABLE 8-1: TYPICAL CONSTRUCTION REFERENCE NOISE LEVELS**

Construction Stage	Reference Construction Activity	Reference Noise Level @ 50 Feet (dBA $L_{eq}$ ) <sup>1</sup>	Combined Noise Level (dBA $L_{eq}$ ) <sup>2</sup>	Combined Sound Power Level (PWL) <sup>3</sup>
Site Preparation	Crawler Tractors	78	80	112
	Hauling Trucks	72		
	Rubber Tired Dozers	75		
Grading	Graders	81	83	115
	Excavators	77		
	Compactors	76		
Building Construction	Cranes	73	81	113
	Tractors	80		
	Welders	70		
Paving	Pavers	74	83	115
	Paving Equipment	82		
	Rollers	73		
Architectural Coating	Cranes	73	77	109
	Air Compressors	74		
	Generator Sets	70		

<sup>1</sup> FHWA Roadway Construction Noise Model (RCNM).

<sup>2</sup> Represents the combined noise level for all equipment assuming they operate at the same time consistent with FTA Transit Noise and Vibration Impact Assessment guidance.

<sup>3</sup> Sound power level represents the total amount of acoustical energy (noise level) produced by a sound source independent of distance or surroundings. Sound power levels calibrated using the CadnaA noise model at the reference distance to the noise source.

**TABLE 8-2: CONSTRUCTION EQUIPMENT NOISE LEVEL SUMMARY**

Receiver Location <sup>1</sup>	Construction Noise Levels (dBA L <sub>eq</sub> )					
	Site Preparation	Grading	Building Construction	Paving	Architectural Coating	Highest Levels <sup>2</sup>
R1	65.8	68.8	66.8	68.8	62.8	68.8
R2	65.6	68.6	66.6	68.6	62.6	68.6
R3	69.6	72.6	70.6	72.6	66.6	72.6
R4	61.5	64.5	62.5	64.5	58.5	64.5
R5	64.8	67.8	65.8	67.8	61.8	67.8
at 200'	60.6	63.6	61.6	63.6	57.6	63.6

<sup>1</sup> Noise receiver locations are shown on Exhibit 8-A.

<sup>2</sup> Construction noise level calculations based on distance from the construction activity, which is measured from the Project site boundary to the nearest receiver locations. CadnaA construction noise model inputs are included in Appendix 8.1.

### 8.4 CONSTRUCTION NOISE LEVEL COMPLIANCE

To evaluate whether the Project will generate potentially significant short-term noise levels at nearest receiver locations, a construction-related daytime noise level threshold of 80 dBA L<sub>eq</sub> is used as a reasonable threshold to assess the daytime construction noise level impacts. The construction noise analysis shows on Table 8-3 that the nearest receiver locations will not exceed the reasonable daytime 80 dBA L<sub>eq</sub> significance threshold or the City of Moreno Valley daytime 65 dBA L<sub>eq</sub> significance threshold at 200 feet during Project construction activities. Therefore, the unmitigated noise impacts due to Project construction activities are considered *less than significant*.

**TABLE 8-3: TYPICAL CONSTRUCTION NOISE LEVEL COMPLIANCE**

Receiver Location <sup>1</sup>	Concrete Pour Noise Levels (dBA L <sub>eq</sub> )		
	Exterior Noise Levels <sup>2</sup>	Threshold <sup>3</sup>	Threshold Exceeded? <sup>4</sup>
R1	68.8	80	No
R2	68.6	80	No
R3	72.6	80	No
R4	64.5	80	No
R5	67.8	80	No
at 200'	63.6	65	No

<sup>1</sup> Construction noise source and receiver locations are shown on Exhibit 8-A.

<sup>2</sup> Highest construction noise level calculations based on distance from the construction noise source activity to the nearest receiver locations as shown on Table 8-2.

<sup>3</sup> Construction noise level thresholds as shown on Table 4-1.

<sup>4</sup> Do the estimated Project construction noise levels exceed the construction noise level threshold?

## 8.5 NIGHTTIME CONCRETE POUR NOISE ANALYSIS

It is our understanding that nighttime concrete pouring activities will occur as a part of Project building construction activities. Nighttime concrete pouring activities are often used to support reduced concrete mixer truck transit times and lower air temperatures than during the daytime hours and are generally limited to the actual building pad area as shown on Exhibit 8-B. Since the nighttime concrete pours may take place outside the permitted City of Moreno Valley Municipal Code, Section 11.80.030[D][7] hours of 7:00 a.m. to 8:00 p.m. on any day and grading is limited to 7:00 a.m. to 6:00 p.m. Monday to Friday and 8:00 a.m. to 4:00 p.m. on weekends and holidays, the Project Applicant will require an exemption from the City of Moreno Valley Municipal Code as indicated in Section 11.80.030[E][8] for a special event permit (Section 11.80.040). The special event permit application shall be submitted to the City of Moreno Valley Planning Department for approval and meet the nighttime exterior construction noise level threshold of 60 dBA  $L_{eq}$  for noise sensitive residential land use.

### 8.5.1 NIGHTTIME CONCRETE POUR REFERENCE NOISE LEVEL MEASUREMENTS


To estimate the noise levels due to nighttime concrete pouring activities, sample reference noise level measurements were taken during a nighttime concrete pouring at a construction site. Urban Crossroads, Inc. collected short-term nighttime concrete pour reference noise level measurements during the noise-sensitive nighttime hours between 1:00 a.m. to 2:00 a.m. at 27334 San Bernardino Avenue in the City of Redlands. The reference noise levels describe the expected concrete pour noise sources that may include concrete mixer truck movements and pouring activities, concrete paving equipment, rear mounted concrete mixer truck backup alarms, engine idling, air brakes, generators, and workers communicating/whistling.

To describe the nighttime concrete pour noise levels associated with the construction of the Bay & Day Commerce Center, this analysis relies on reference sound power level of 100.3 dBA  $L_w$ . While the Project noise levels will depend on the actual duration of activities and specific equipment fleet in use at the time of construction, the reference sound power level of 100.3 dBA  $L_w$  is used to describe the expected Project nighttime concrete pour noise activities.

### 8.5.2 NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE

As shown on Table 8-4, the noise levels associated with the nighttime concrete pour activities are estimated to range from 46.9 to 54.9 dBA  $L_{eq}$  and 46.9 dBA  $L_{eq}$  at 200 feet. The analysis shows that the unmitigated nighttime concrete pour activities will not exceed the reasonable nighttime 70 dBA  $L_{eq}$  significance threshold or the City of Moreno Valley daytime 60 dBA  $L_{eq}$  significance threshold at 200 feet during Project nighttime concrete pour activities. Appendix 8.2 includes the CadnaA nighttime concrete pour noise model inputs. Therefore, the unmitigated nighttime concrete pour noise level impacts are considered *less than significant*.

**EXHIBIT 8-B: NIGHTTIME CONCRETE POUR NOISE SOURCE AND RECEIVER LOCATIONS**

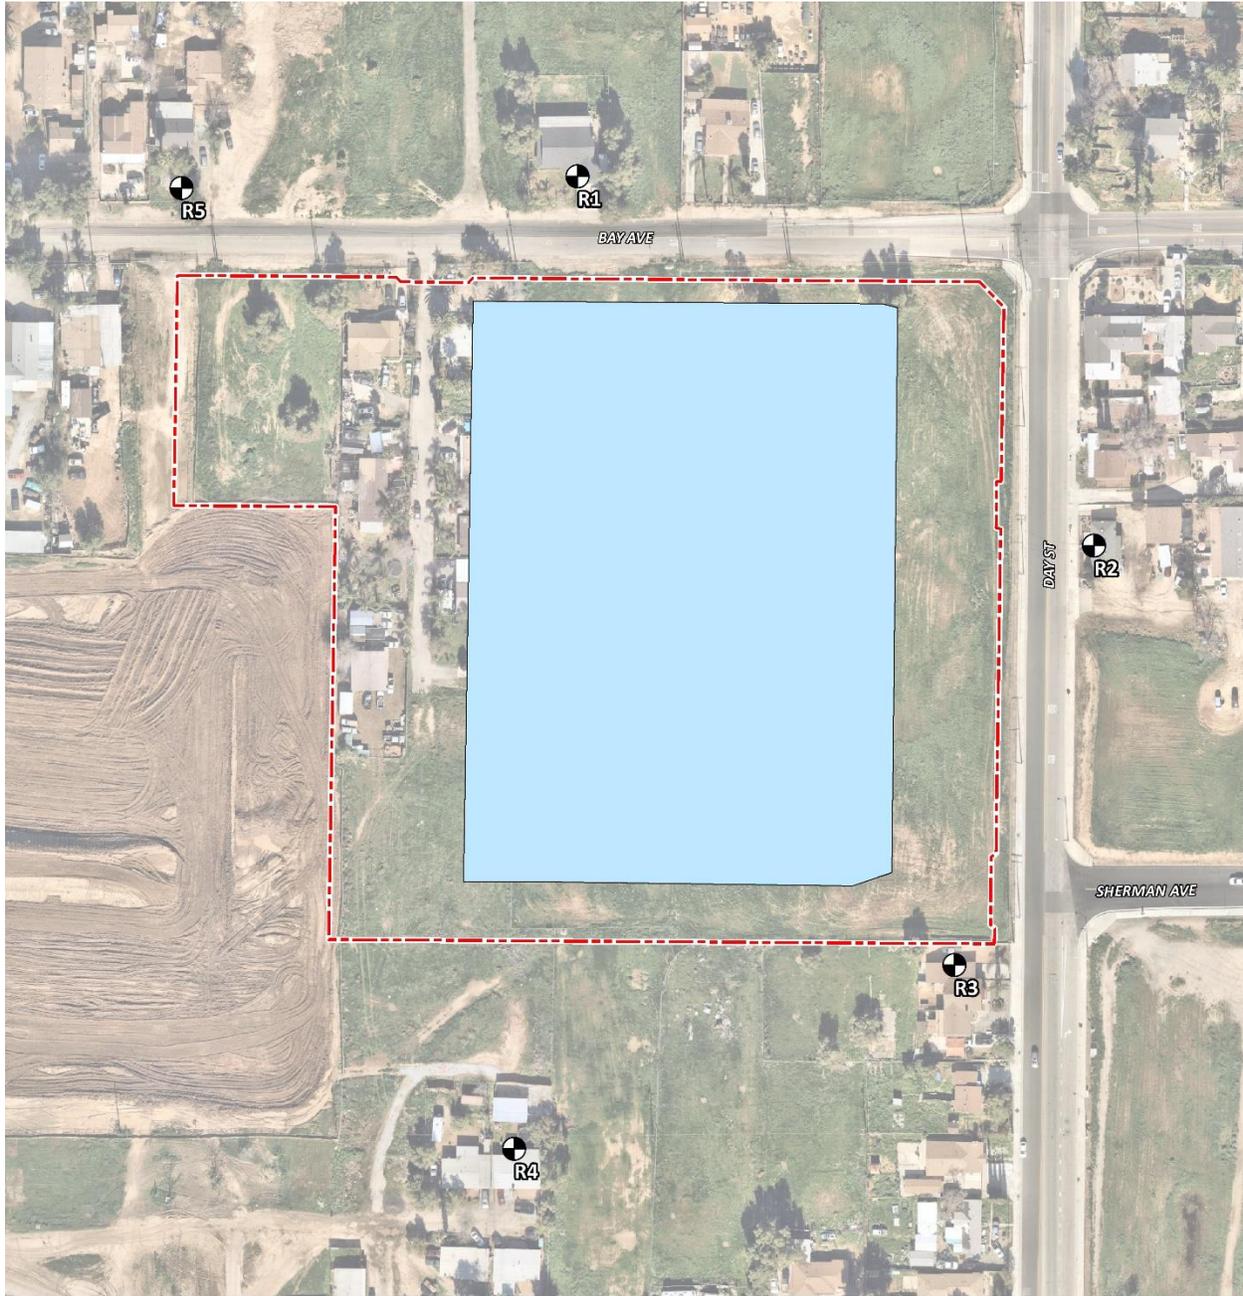

**LEGEND:**  
N ↑  
[Red dashed line] Site Boundary [Blue shaded area] Nighttime Concrete Pour Activity [Black circle with crosshair] Receiver Locations

**TABLE 8-4: NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE**

Receiver Location <sup>1</sup>	Concrete Pour Noise Levels (dBA Leq)		
	Exterior Noise Levels <sup>2</sup>	Threshold <sup>3</sup>	Threshold Exceeded? <sup>4</sup>
R1	54.9	70	No
R2	52.8	70	No
R3	54.7	70	No
R4	48.5	70	No
R5	49.3	70	No
at 200'	46.9	60	No

<sup>1</sup> Construction noise source and receiver locations are shown on Exhibit 8-A.

<sup>2</sup> Construction noise level calculations based on distance from the concrete pour activity, which is measured from the Project building to the nearest receiver locations. CadnaA concrete pour noise model inputs are included in Appendix 8.2.

<sup>3</sup> Construction noise level standards as shown on Table 4-1.

<sup>4</sup> Do the estimated Project construction noise levels exceed the construction noise level threshold?

## 8.6 CONSTRUCTION VIBRATION ANALYSIS

Construction activity can result in varying degrees of ground vibration, depending on the equipment and methods employed. The operation of construction equipment causes ground vibrations that spread through the ground and diminish in strength with distance. Ground vibration levels associated with various types of construction equipment are summarized on Table 8-5. Based on the representative vibration levels presented for various construction equipment types, it is possible to estimate the potential for human response (annoyance) and building damage using the following vibration assessment methods defined by the FTA. To describe the vibration impacts the FTA provides the following equation:  $PPV_{\text{equip}} = PPV_{\text{ref}} \times (25/D)^{1.5}$

**TABLE 8-5: VIBRATION SOURCE LEVELS FOR CONSTRUCTION EQUIPMENT**

Equipment	PPV (in/sec) at 25 feet
Small bulldozer	0.003
Jackhammer	0.035
Loaded Trucks	0.076
Large bulldozer	0.089

Federal Transit Administration, Transit Noise and Vibration Impact Assessment Manual

Table 8-6 presents the expected Project related vibration levels at the nearby receiver locations. At distances ranging from 20 to 200 feet from Project construction activities, construction vibration velocity levels are estimated to range from 0.004 to 0.124 in/sec PPV. Based on maximum acceptable continuous vibration threshold of 0.3 PPV (in/sec), the typical Project construction vibration levels will satisfy the building damage thresholds at all the noise sensitive

receiver locations. In addition, the typical construction vibration levels at the nearest sensitive receiver locations are unlikely to be sustained during the entire construction period but will occur rather only during the times that heavy construction equipment is operating adjacent to the Project site boundaries.

**TABLE 8-6: CONSTRUCTION EQUIPMENT VIBRATION LEVELS**

Receiver <sup>1</sup>	Distance to Const. Activity (Feet) <sup>2</sup>	Typical Construction Vibration Levels PPV (in/sec) <sup>3</sup>					Thresholds PPV (in/sec) <sup>4</sup>	Thresholds Exceeded? <sup>5</sup>
		Small bulldozer	Jack-hammer	Loaded Trucks	Large bulldozer	Highest Vibration Level		
R1	96'	0.000	0.005	0.010	0.012	0.012	0.3	No
R2	88'	0.000	0.005	0.012	0.013	0.013	0.3	No
R3	20'	0.004	0.049	0.106	0.124	0.124	0.3	No
R4	195'	0.000	0.002	0.003	0.004	0.004	0.3	No
R5	77'	0.001	0.006	0.014	0.016	0.016	0.3	No
at 200'	200'	0.000	0.002	0.003	0.004	0.004	0.3	No

<sup>1</sup> Receiver locations are shown on Exhibit 8-A.

<sup>2</sup> Distance from receiver location to Project construction boundary (Project site boundary).

<sup>3</sup> Based on the Vibration Source Levels of Construction Equipment (Table 8-5).

<sup>4</sup> Caltrans Transportation and Construction Vibration Guidance Manual, April 2020, Table 19, p. 38.

<sup>5</sup> Does the peak vibration exceed the acceptable vibration thresholds?

"PPV" = Peak Particle Velocity

## 9 REFERENCES

1. **State of California.** *California Environmental Quality Act, Appendix G.* 2018.
2. **California Department of Transportation Environmental Program.** *Technical Noise Supplement - A Technical Supplement to the Traffic Noise Analysis Protocol.* Sacramento, CA : s.n., September 2013.
3. **Environmental Protection Agency Office of Noise Abatement and Control.** *Information on Levels of Environmental Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety.* March 1974. EPA/ONAC 550/9/74-004.
4. **U.S. Department of Transportation, Federal Highway Administration, Office of Environment and Planning, Noise and Air Quality Branch.** *Highway Traffic Noise Analysis and Abatement Policy and Guidance.* December 2011.
5. **U.S. Department of Transportation Federal Highway Administration.** *Highway Noise Barrier Design Handbook.* 2001.
6. **U.S. Department of Transportation, Federal Highway Administration.** *Highway Traffic Noise in the United States, Problem and Response.* April 2000. p. 3.
7. **U.S. Environmental Protection Agency Office of Noise Abatement and Control.** *Noise Effects Handbook-A Desk Reference to Health and Welfare Effects of Noise.* October 1979 (revised July 1981). EPA 550/9/82/106.
8. **U.S. Department of Transportation, Federal Transit Administration.** *Transit Noise and Vibration Impact Assessment Manual.* September 2018.
9. **Office of Planning and Research.** *State of California General Plan Guidelines.* October 2017.
10. **City of Moreno Valley.** *General Plan Safety Element.* July 2006.
11. —. *Municipal Code, Chapter 11.80 Noise Regulation.*
12. **California Department of Transportation.** *Transportation and Construction Vibration Guidance Manual.* April 2020.
13. **Riverside County Airport Land Use Commission.** *March Air Reserve Base/Inland Port Airport Land Use Compatibility Plan.* November 2014.
14. **California Court of Appeal.** *Gray v. County of Madera, F053661.* 167 Cal.App.4th 1099; - Cal.Rptr.3d, October 2008.
15. **Federal Interagency Committee on Noise.** *Federal Agency Review of Selected Airport Noise Analysis Issues.* August 1992.
16. **California Department of Transportation.** *Technical Noise Supplement.* November 2009.
17. **American National Standards Institute (ANSI).** *Specification for Sound Level Meters ANSI S1.4-2014/IEC 61672-1:2013.*
18. **U.S. Department of Transportation, Federal Highway Administration, Office of Environment and Planning.** *FHWA Roadway Construction Noise Model.* January, 2006.

*This page intentionally left blank*

## 10 CERTIFICATION

The contents of this noise study report represent an accurate depiction of the noise environment and impacts associated with the proposed Bay & Day Commerce Center Project. The information contained in this noise study report is based on the best available data at the time of preparation. If you have any questions, please contact me directly at (949) 584-3148.

Bill Lawson, P.E., INCE  
Principal  
URBAN CROSSROADS, INC.  
1133 Camelback #8329  
Newport Beach, CA 92658  
(949) 581-3148  
[blawson@urbanxroads.com](mailto:blawson@urbanxroads.com)



### EDUCATION

Master of Science in Civil and Environmental Engineering  
California Polytechnic State University, San Luis Obispo • December, 1993

Bachelor of Science in City and Regional Planning  
California Polytechnic State University, San Luis Obispo • June, 1992

### PROFESSIONAL REGISTRATIONS

PE – Registered Professional Traffic Engineer – TR 2537 • January, 2009  
AICP – American Institute of Certified Planners – 013011 • June, 1997–January 1, 2012  
PTP – Professional Transportation Planner • May, 2007 – May, 2013  
INCE – Institute of Noise Control Engineering • March, 2004

### PROFESSIONAL AFFILIATIONS

ASA – Acoustical Society of America  
ITE – Institute of Transportation Engineers

### PROFESSIONAL CERTIFICATIONS

Certified Acoustical Consultant – County of Orange • February, 2011  
FHWA-NHI-142051 Highway Traffic Noise Certificate of Training • February, 2013

*This page intentionally left blank*

**APPENDIX 3.1:**

**CITY OF MORENO VALLEY MUNICIPAL CODE**

*This page intentionally left blank*

## Moreno Valley Municipal Code

Up Previous Next Main Collapse Search Print No Frames

[Title 11 PEACE, MORALS AND SAFETY](#)

## Chapter 11.80 NOISE REGULATION

---

### 11.80.010 Legislative findings.

---

It is found and declared that:

- A. Excessive sound within the limits of the city is a condition which has existed for some time, and the amount and intensity of such sound is increasing.
- B. Such excessive sound is a detriment to the public health, safety, and welfare and quality of life of the residents of the city.
- C. The necessity in the public interest for the provisions and prohibitions hereinafter contained and enacted is declared as a matter of legislative determination and public policy, and it is further declared that the provisions and prohibitions hereinafter contained and enacted are in pursuance of and for the purpose of securing and promoting the public health, safety, welfare and quality of life of the city and its inhabitants. (Ord. 740 § 1.2, 2007)

### 11.80.020 Definitions.

---

For purposes of this chapter, certain words and phrases used herein are defined as follows:

“A-weighted sound level” means the sound pressure level in decibels as measured with a sound level meter using the A-weighting network. The unit of measurement is the dB(A).

“Commercial” means all uses of land not otherwise classified as residential, as defined in this section.

“Construction” means any site preparation, and/or any assembly, erection, repair, or alteration, excluding demolition, of any structure, or improvements to real property.

“Continuous airborne sound” means sound that is measured by the slow-response setting of a meter manufactured to the specifications of ANSI Section 1.4-1983 (R2006) “Specification for Sound Level Meters,” or its successor.

“Daytime” means eight a.m. to ten p.m. the same day.

“Decibel” (dB) means a unit for measuring the amplitude of sound, equal to twenty (20) times the logarithm to the base ten (10) of the ratio of the pressure of the sound measured to the reference pressure, which is twenty (20) microPascals (twenty (20) microNewtons per square meter.)

“Demolition” means any dismantling, intentional destruction or removal of structures or other improvements to real property.

“Disturb” means to interrupt, interfere with, or hinder the enjoyment of peace or quiet or the normal listening activities or the sleep, rest or mental concentration of the hearer.

“Emergency” means any occurrence or set of circumstances involving actual or imminent physical trauma or significant property damage which necessitates immediate action. Economic loss alone shall not constitute an emergency. It shall be the burden of an alleged violator to prove an “emergency.”

“Emergency work” means any work made necessary to restore property to a safe condition following an emergency, or to protect persons or property threatened by an imminent emergency, to the extent such work is, in fact, necessary to protect persons or property from exposure to imminent danger or damage.

“Frequency” means the number of complete oscillation cycles per unit of time.

“Impulsive sound” means sound of short duration, usually less than one second, with an abrupt onset and rapid decay. Examples of sources of impulsive sound include explosions, drop forge impacts, and discharge of firearms.

“Nighttime” means 10:01 p.m. to 7:59 a.m. the following day.

“Noise disturbance” means any sound which:

1. Disturbs a reasonable person of normal sensitivities;

2. Exceeds the sound level limits set forth in this chapter; or

3. Is plainly audible as defined in this section. Where no specific distance is set forth for the determination of audibility, references to noise disturbance shall be deemed to mean plainly audible at a distance of two hundred (200) feet from the real property line of the source of the sound, if the sound occurs on privately owned property, or from the source of the sound, if the sound occurs on public right-of-way, public space or other publicly owned property.

“Person” means any person, person’s firm, association, copartnership, joint venture, corporation, or any entity public or private in nature.

“Plainly audible” means that the sound or noise produced or reproduced by any particular source, can be clearly distinguished from ambient noise by a person using his/her normal hearing faculties.

“Public right-of-way” means any street, avenue, boulevard, sidewalk, bike path or alley, or similar place normally accessible to the public which is owned or controlled by a governmental entity.

“Public space” means any park, recreational or community facility, or lot which contains at least one building that is open to the general public during its hours of operation.

“Residential” means all uses of land primarily for dwelling units, as well as hospitals, schools, colleges and universities, and places of religious assembly.

“Sound” means an oscillation in pressure, particle displacement, particle velocity or other physical parameter, in a medium with internal forces that causes compression and rarefaction of that medium capable of producing an auditory impression. The description of sound may include any characteristic of such sound, including duration, intensity and frequency.

“Sound level” means the weighted sound pressure level as measured in dB(A) by a sound level meter and as specified in American National Standards Institute (ANSI) specifications for sound-level meters (ANSI Section 1.4-1971 (R1976)). If the frequency weighting employed is not indicated, the A-weighting shall apply.

“Sound level meter” means an instrument, demonstrably capable of accurately measuring sound levels as defined above.

All technical definitions not defined above shall be in accordance with applicable publications and standards of the American National Standards Institute (ANSI). (Ord. 740 § 1.2, 2007)

### **11.80.030 Prohibited acts.**

A. General Prohibition. It is unlawful and a violation of this chapter to maintain, make, cause, or allow the making of any sound that causes a noise disturbance, as defined in Section [11.80.020](#).

B. Sound causing permanent hearing loss.

1. Sound level limits. Based on statistics from the Center for Disease Control and Prevention and the National Institute for Occupational Safety and Health, Table 1 and Table 1-A specify sound level limits which, if exceeded, will have a high probability of producing permanent hearing loss in anyone in the area where the sound levels are being exceeded. No sound shall be permitted within the city which exceeds the parameters set forth in Tables 11.80.030-1 and 11.80.030-1-A of this chapter:

**Table 11.80.030-1**

**MAXIMUM CONTINUOUS SOUND LEVELS\***

<b>Duration per Day</b>	
<b>Continuous Hours</b>	<b>Sound level [db(A)]</b>
8	90
6	92
4	95
3	97

2	100
1.5	102
1	105
0.5	110
0.25	115

\* When the daily sound exposure is composed of two or more periods of sound exposure at different levels, the combined effect of all such periods shall constitute a violation of this section if the sum of the percent of allowed period of sound exposure at each level exceeds 100 percent

**Table 11.80.030-1A  
MAXIMUM IMPULSIVE SOUND  
LEVELS**

<b>Number of Repetitions per 24-Hour Period</b>	<b>Sound level [dB(A)]</b>
1	145
10	135
100	125

2. Exemptions. No violation shall exist if the only persons exposed to sound levels in excess of those listed in Tables 11.80.030-1 and 11.80.030-1A are exposed as a result of:

- a. Trespass;
- b. Invitation upon private property by the person causing or permitting the sound; or
- c. Employment by the person or a contractor of the person causing or permitting the sound.

C. Nonimpulsive Sound Decibel Limits. No person shall maintain, create, operate or cause to be operated on private property any source of sound in such a manner as to create any nonimpulsive sound which exceeds the limits set forth for the source land use category (as defined in Section [11.80.020](#)) in Table 11.80.030-2 when measured at a distance of two hundred (200) feet or more from the real property line of the source of the sound, if the sound occurs on privately owned property, or from the source of the sound, if the sound occurs on public right-of-way, public space or other publicly owned property. Any source of sound in violation of this subsection shall be deemed prima facie to be a noise disturbance.

**Table 11.80.030-2  
MAXIMUM SOUND LEVELS (IN dB(A)) FOR SOURCE LAND USES**

<b>Residential</b>		<b>Commercial</b>	
<b>Daytime</b>	<b>Nighttime</b>	<b>Daytime</b>	<b>Nighttime</b>
60	55	65	60

D. Specific Prohibitions. In addition to the general prohibitions set out in subsection A of this section, and unless otherwise exempted by this chapter, the following specific acts, or the causing or permitting thereof, are regulated as follows:

1. Motor Vehicles. No person shall operate or cause to be operated a public or private motor vehicle, or combination of vehicles towed by a motor vehicle, that creates a sound exceeding the sound level limits in Table 11.80.030-2 when the vehicle(s) are not otherwise subject to noise regulations provided for by the California [Vehicle Code](#).

2. Radios, Televisions, Electronic Audio Equipment, Musical Instruments or Similar Devices from a Stationary Source. No person shall operate, play or permit the operation or playing of any radio, tape player, television, electronic audio equipment, musical instrument, sound amplifier or other mechanical or electronic sound making device that produces, reproduces or amplifies sound in such a manner as to create a noise disturbance. However, this subsection shall not apply to any use or activity exempted in subsection E of this section and any use or activity for which a special permit has been issued pursuant to Section [11.80.040](#).

3. Radios, Electronic Audio Equipment, or Similar Devices from a Mobile Source Such as a Motor Vehicle. Sound amplification or reproduction equipment on or in a motor vehicle is subject to regulation in accordance with the California [Vehicle Code](#) when upon the public right-of-way. When upon public space or publicly owned property other than the public right-of-way or upon private property open to the public, sound amplification or reproduction equipment shall not be operated in such a manner that it is plainly audible at a distance of fifty (50) feet in any direction from the vehicle.

4. Portable, Hand-Held Music or Sound Amplification or Reproduction Equipment. Such equipment shall not be operated on a public right-of-way, public space or other publicly owned property in such a manner as to be plainly audible at a distance of fifty (50) feet in any direction from the operator.

5. Loudspeakers and Public Address Systems.

a. Except as permitted by Section [11.80.040](#), no person shall operate, or permit the operation of, any loudspeaker, public address system or similar device, for any commercial purpose:

1. Which produces, reproduces or amplifies sound in such a manner as to create a noise disturbance; or
2. During nighttime hours on a public right-of-way, public space or other publicly owned property.

b. No person shall operate, or permit the operation of, any loudspeaker, public address system or similar device, for any noncommercial purpose, during nighttime hours in such a manner as to create a noise disturbance.

6. Animals. No person shall own, possess or harbor an animal or bird that howls, barks, meows, squawks, or makes other sounds that:

a. Create a noise disturbance;

b. Are of frequent or continued duration for ten (10) or more consecutive minutes and are plainly audible at a distance of fifty (50) feet from the real property line of the source of the sound; or

c. Are intermittent for a period of thirty (30) or more minutes and are plainly audible at a distance of fifty (50) feet from the real property line of the source of the sound.

7. Construction and Demolition. No person shall operate or cause the operation of any tools or equipment used in construction, drilling, repair, alteration or demolition work between the hours of eight p.m. and seven a.m. the following day such that the sound there from creates a noise disturbance, except for emergency work by public service utilities or for other work approved by the city manager or designee. This section shall not apply to the use of power tools as provided in subsection (D)(9) of this section.

8. Emergency Signaling Devices. No person shall intentionally sound or permit the sounding outdoors of any fire, burglar or civil defense alarm, siren or whistle, or similar stationary emergency signaling device, except for emergency purposes or for testing as follows:

a. Testing of a stationary emergency signaling device shall not occur between seven p.m. and seven a.m. the following day;

b. Testing of a stationary emergency signaling device shall use only the minimum cycle test time, in no case to exceed sixty (60) seconds;

c. Testing of a complete emergency signaling system, including the functioning of the signaling device and the personnel response to the signaling device, shall not occur more than once in each calendar month. Such testing shall only occur only on weekdays between seven a.m. and seven p.m. and shall be exempt from the time limit specified in subsection (D)(8)(2) of this section.

9. Power Tools. No person shall operate or permit the operation of any mechanically, electrically or gasoline motor-driven tool during nighttime hours so as to cause a noise disturbance across a residential real property boundary.

10. Pumps, Air Conditioners, Air-Handling Equipment and Other Continuously Operating Equipment. Notwithstanding the general prohibitions of subsection a of this section, no person shall operate or permit the operation of any pump, air

conditioning, air-handling or other continuously operating motorized equipment in a state of disrepair or in a manner which otherwise creates a noise disturbance distinguishable from normal operating sounds.

E. Exemptions. The following uses and activities shall be exempt from the sound level regulations except the maximum sound levels provided in Tables 11.80.030-1 and 11.80.030-1A:

1. Sounds resulting from any authorized emergency vehicle when responding to an emergency call or acting in time of an emergency.
2. Sounds resulting from emergency work as defined in Section [11.80.020](#)
3. Any aircraft operated in conformity with, or pursuant to, federal law, federal air regulations and air traffic control instruction used pursuant to and within the duly adopted federal air regulations; and any aircraft operating under technical difficulties in any kind of distress, under emergency orders of air traffic control, or being operated pursuant to and subsequent to the declaration of an emergency under federal air regulations.
4. All sounds coming from the normal operations of interstate motor and rail carriers, to the extent that local regulation of sound levels of such vehicles has been preempted by the Noise Control Act of 1972 (42 U.S.C. § 4901 et seq.) or other applicable federal laws or regulations
5. Sounds from the operation of motor vehicles, to the extent they are regulated by the California [Vehicle Code](#).
6. Any constitutionally protected noncommercial speech or expression conducted within or upon a any public right-of-way, public space or other publicly owned property constituting an open or a designated public forum in compliance with any applicable reasonable time, place and manner restrictions on such speech or expression or otherwise pursuant to legal authority.
7. Sounds produced at otherwise lawful and permitted city-sponsored events, organized sporting events, school assemblies, school playground activities, by permitted fireworks, and by permitted parades on public right-of-way, public space or other publicly owned property.
8. An event for which a temporary use permit or special event permit has been issued under other provisions of this code, where the provisions of Section [11.80.040](#) are met, the permit granted expressly grants an exemption from specific standards contained in this chapter, and the permittee and all persons under the permittee's reasonable control actually comply with all conditions of such permit. Violation of any condition of such a permit related to sound or sound equipment shall be a violation of this chapter and punishable as such.

F. Nothing in this chapter shall be construed to limit, modify or repeal any other regulation elsewhere in this code relating to the regulation of noise sources, nor shall any such other regulation be read to permit the emission of noise in violation of any provision of this chapter. (Ord. 740 § 1.2, 2007)

#### **11.80.040 Special provisions for temporary use and special event permits.**

The exemption by permit set forth in Section [11.80.030](#)(E)(8) shall be subject to the following requirements and conditions:

- A. The permit application shall include the name, address and telephone number of the permit applicant; the date, hours and location for which the permit is requested; and the nature of the event or activity. It shall also specify the types of sounds and/or sound equipment to be permitted, the proposed duration of such sound, the specific standards from which the sound is to be exempted, and the reasons for each requested exemption.
- B. The permit shall be issued provided the proposed activity meets the requirements of this section and the issuing official determines that the sound to be emitted at the event as proposed would not be detrimental to the public health, safety or welfare, that the event cannot reasonably achieve its legitimate aims and purposes without the exemption and that the sound levels proposed will not unreasonably damage the peace and quiet enjoyment of the lawful users of surrounding properties, nor constitute a public nuisance.
- C. The official issuing the permit may prescribe any reasonable conditions or requirements he/she deems necessary to minimize noise disturbances upon the community or the surrounding neighborhood, and/or to protect the health, safety or welfare of the public, including participants in the permitted event, including use of mufflers, screens or other sound-attenuating devices.
- D. Any permit granted must be in writing and shall contain all conditions upon which the permit shall be effective.

E. No more than six events requiring a sound limit exemption may be held at any particular location upon privately owned or controlled property per calendar year, provided further that the number of events shall not exceed the number permitted under the regulations for the type of permit issued. For purposes of this subsection, "location" means a legal parcel of real property or a complete shopping or commercial center or mall sharing common parking and access even if comprised of multiple legal parcels.

F. The exemption from sound limits under such permit shall not exceed maximum period of four hours in one twenty-four (24) hour day.

G. The permit will only be granted for hours between nine a.m. and ten p.m. on all days other than Friday and Saturday; and, on Friday and Saturday, between the hours of nine a.m. and one a.m. of the following day, except in the following circumstances:

1. A permit may be granted for hours between nine a.m. on New Year's Eve and one a.m. the following day (New Year's Day).

2. A permit may be granted for hours between nine a.m. and two a.m. the following day if there are no residences, hospitals, or nursing homes within a 0.5 mile radius of the property where the function is taking place.

H. Functions for which the permits are issued shall be limited to a continuous airborne sound level not to exceed seventy (70) dB(A), as measured two hundred (200) feet from the real property boundary of the source property if on private property, or from the source if on public right-of-way, public space or other publicly owned property. (Ord. 740 § 1.2, 2007)

### **11.80.050 Measurement or assessment of sound.**

#### **A. Measurement With Sound Meter.**

1. The measurement of sound shall be made with a sound level meter meeting the standards prescribed by ANSI Section 1.4-1983 (R2006). The instruments shall be maintained in calibration and good working order. A calibration check shall be made of the system at the time of any sound level measurement. Measurements recorded shall be taken so as to provide a proper representation of the source of the sound. The microphone during measurement shall be positioned so as not to create any unnatural enhancement or diminution of the measured sound. A windscreen for the microphone shall be used at all times. However, a violation of this chapter may occur without the occasion of the measurements being made as otherwise provided.

2. The slow meter response of the sound level meter shall be used in order to best determine the average amplitude.

3. The measurement shall be made at any point on the property into which the sound is being transmitted and shall be made at least three feet away from any ground, wall, floor, ceiling, roof and other plane surface.

4. In case of multiple occupancy of a property, the measurement may be made at any point inside the premises to which any complainant has right of legal private occupancy; provided that the measurement shall not be made within three feet of any ground, wall, floor, ceiling, roof or other plane surface.

5. All measurements of sound provided for in this chapter will be made by qualified officials of the city who are designated by the city manager or designee to operate the apparatus used to make the measurements.

**B. Assessment Without Sound Level Meter.** Any police officer, code enforcement officer, or other official designated by the city manager or designee who hears a noise or sound that is plainly audible, as defined in Section [11.80.020](#), in violation of this chapter, may enforce this chapter and shall assess the noise or sound according to the following standards:

1. The primary means of detection shall be by means of the official's normal hearing faculties, not artificially enhanced.

2. The official shall first attempt to have a direct line of sight and hearing to the vehicle or real property from which the sound or noise emanates so that the official can readily identify the offending source of the sound or noise and the distance involved. If the official is unable to have a direct line of sight and hearing to the vehicle or real property from which the sound or noise emanates, then the official shall confirm the source of the sound or noise by approaching the suspected vehicle or real property until the official is able to obtain a direct line of sight and hearing, and confirm the source of the sound or noise that was heard at the place of the original assessment of the sound or noise.

3. The official need not be required to identify song titles, artists, or lyrics in order to establish a violation. (Ord. 740 § 1.2, 2007)

#### **11.80.060 Violation.**

---

A. **Violation of Sound Level Limits.** Any person violating any of the provisions of this chapter shall be deemed guilty of a misdemeanor, and upon conviction thereof shall be punishable by a fine not to exceed one thousand dollars (\$1,000.00) and/or six months in the county jail, or both. Notwithstanding the foregoing, any violation of the provisions of this chapter may, in the discretion of the citing officer or the city attorney, be cited and/or prosecuted as an infraction or be subject to civil citation pursuant to Chapter [1.10](#).

B. **Joint and Several Responsibility.** In addition to the person causing the offending sound, the owner, tenant or lessee of property, or a manager, overseer or agent, or any other person lawfully entitled to possess the property from which the offending sound is emitted at the time the offending sound is emitted, shall be responsible for compliance with this chapter if the additionally responsible party knows or should have known of the offending noise disturbance. It shall not be a lawful defense to assert that some other person caused the sound. The lawful possessor or operator of the premises shall be responsible for operating or maintaining the premises in compliance with this chapter and may be cited regardless of whether or not the person actually causing the sound is also cited.

C. **Violation May be Declared a Public Nuisance.** The operation or maintenance of any device, equipment, instrument, vehicle or machinery in violation of any provisions of this chapter which endangers the public health, safety and quality of life of residents in the area is declared to be a public nuisance, and may be subject to abatement summarily or by a restraining order or injunction issued

by a court of competent jurisdiction. (Ord. 824 § 1.2, 2011; Ord. 740 § 1.2, 2007)

---

View the [mobile version](#).

*This page intentionally left blank*

**APPENDIX 5.1:**  
**STUDY AREA PHOTOS**

*This page intentionally left blank*

**JN:13796**



**L1\_E**  
33, 55' 12.350000"117, 16' 45.880000"



**L1\_N**  
33, 55' 12.350000"117, 16' 45.880000"



**L1\_S**  
33, 55' 12.350000"117, 16' 45.880000"



**L1\_W**  
33, 55' 10.550000"117, 16' 46.760000"



**L2\_E**  
33, 55' 10.630000"117, 16' 44.340000"



**L2\_N**  
33, 55' 10.730000"117, 16' 44.370000"

**JN:13796**



**L2\_S**  
**33, 55' 10.680000"117, 16' 44.370000"**



**L2\_W**  
**33, 55' 10.660000"117, 16' 44.340000"**



**L3\_E**  
**33, 55' 8.720000"117, 16' 43.790000"**



**L3\_N**  
**33, 55' 9.550000"117, 16' 48.190000"**



**L3\_S**  
**33, 55' 8.720000"117, 16' 43.790000"**



**L3\_W**  
**33, 55' 8.720000"117, 16' 43.790000"**

**JN:13796**



**L4\_E**  
**33, 55' 8.900000"117, 16' 49.310000"**



**L4\_N**  
**33, 55' 8.900000"117, 16' 49.310000"**



**L4\_S**  
**33, 55' 8.900000"117, 16' 49.310000"**



**L4\_W**  
**33, 55' 7.430000"117, 16' 48.850000"**

*This page intentionally left blank*

**APPENDIX 5.2:**  
**NOISE LEVEL MEASUREMENT WORKSHEETS**

*This page intentionally left blank*

## 24-Hour Noise Level Measurement Summary


Date: Wednesday, June 30, 2021  
Project: Edgemont Commerce Center

Location: L1 - Located within the Project site on Bay Avenue near single-  
Source: family residence at 21891 Bay Avenue.

Meter: Piccolo II

JN: 13796  
Analyst: A. Khan

Hourly  $L_{eq}$  dBA Readings (unadjusted)

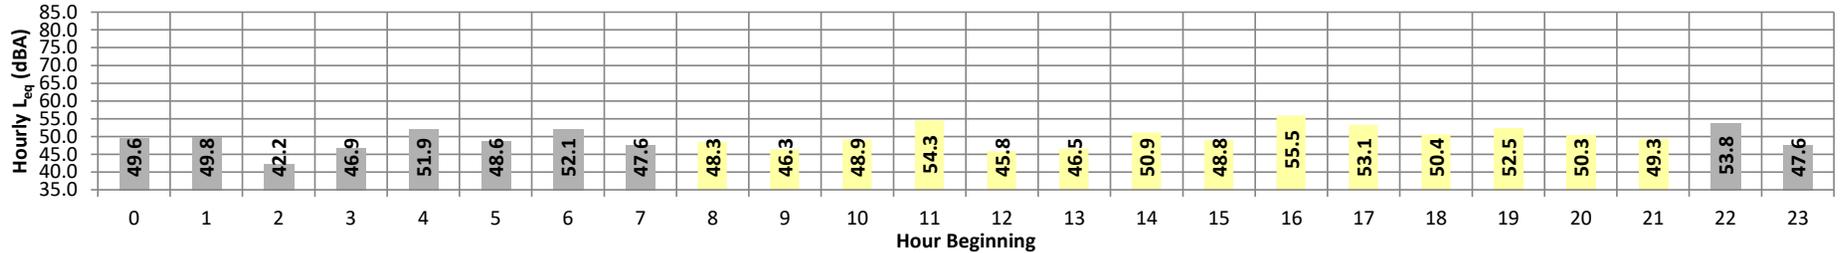

Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$	Adj.	Adj. $L_{eq}$	
Night	0	49.6	81.7	45.5	80.7	79.8	78.3	77.2	72.6	60.0	45.8	45.7	45.5	49.6	10.0	59.6	
	1	49.8	58.4	41.1	57.4	56.4	55.3	54.7	51.6	45.7	41.5	41.3	41.1	49.8	10.0	59.8	
	2	42.2	44.6	40.9	44.3	44.1	43.6	43.3	42.4	42.0	41.3	41.2	41.0	42.2	10.0	52.2	
	3	46.9	57.3	41.8	56.4	54.9	52.7	51.6	45.8	43.0	42.2	42.1	41.9	46.9	10.0	56.9	
	4	51.9	72.5	45.3	71.4	70.3	67.4	62.8	57.7	51.3	46.0	45.7	45.5	51.9	10.0	61.9	
	5	48.6	52.9	46.7	52.5	51.9	51.0	50.4	49.0	48.1	47.2	47.0	46.8	48.6	10.0	58.6	
	6	52.1	62.9	45.1	61.8	61.1	59.9	59.0	55.5	51.4	46.6	46.6	46.0	52.1	10.0	62.1	
	7	47.6	57.5	44.1	56.4	54.6	51.8	50.2	47.3	45.9	44.7	44.5	44.3	47.6	0.0	47.6	
Day	8	48.3	58.3	43.7	57.1	56.2	52.7	51.0	48.4	46.1	44.3	44.1	43.8	48.3	0.0	48.3	
	9	46.3	65.8	42.0	65.3	64.9	63.9	62.7	55.4	46.2	42.5	42.3	42.1	46.3	0.0	46.3	
	10	48.9	67.0	42.6	66.6	66.2	65.3	64.6	58.9	50.1	43.8	43.5	42.7	48.9	0.0	48.9	
	11	54.3	77.4	41.8	75.3	73.1	67.1	62.9	57.3	50.0	42.9	42.5	41.9	54.3	0.0	54.3	
	12	45.8	51.3	42.4	50.8	50.4	49.4	48.9	46.7	44.4	43.0	42.8	42.5	45.8	0.0	45.8	
	13	46.5	51.9	43.7	51.4	50.7	49.4	48.8	46.9	45.9	44.3	44.1	43.8	46.5	0.0	46.5	
	14	50.9	70.2	44.1	69.4	68.9	67.7	66.3	54.7	49.3	44.8	44.5	44.2	50.9	0.0	50.9	
	15	48.8	59.0	44.6	58.0	57.3	56.1	55.3	53.2	51.4	46.9	45.7	44.7	48.8	0.0	48.8	
	16	55.5	63.3	51.1	62.5	62.0	60.4	58.9	55.7	53.7	51.5	51.4	51.2	55.5	0.0	55.5	
	17	53.1	64.1	47.4	63.0	62.0	59.5	57.3	51.5	49.8	48.1	47.8	47.5	53.1	0.0	53.1	
	18	50.4	55.6	47.6	55.2	54.7	53.5	52.8	51.0	49.6	48.2	48.0	47.7	50.4	0.0	50.4	
	19	52.5	67.6	48.6	67.2	66.9	65.9	65.3	56.9	51.2	49.5	49.3	48.9	52.5	5.0	57.5	
	20	50.3	57.7	46.6	57.0	56.3	54.9	53.5	50.7	48.6	47.2	47.0	46.7	50.3	5.0	55.3	
	21	49.3	61.9	46.4	61.7	61.2	60.5	59.0	52.8	49.0	47.0	46.8	46.5	49.3	5.0	54.3	
Night	22	53.8	64.4	45.8	64.1	63.6	62.8	61.9	55.0	49.7	46.4	46.2	45.9	53.8	10.0	63.8	
Night	23	47.6	55.1	46.0	53.8	52.4	49.9	49.0	47.5	47.0	46.3	46.2	46.1	47.6	10.0	57.6	
Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$ (dBA)			
Day	Min	45.8	51.3	41.8	50.8	50.4	49.4	48.8	46.7	44.4	42.5	42.3	41.9	24-Hour	50.6	50.9	Nighttime (10pm-8am)
	Max	55.5	77.4	51.1	75.3	73.1	67.7	66.3	58.9	53.7	51.5	51.4	51.2				
Energy Average		51.0	Average:		61.5	60.8	59.0	57.7	52.8	49.0	46.0	45.7	45.3				
Night	Min	42.2	44.6	40.9	44.3	44.1	43.6	43.3	42.4	42.0	41.3	41.2	41.0	24-Hour	50.6	50.9	50.0
	Max	53.8	81.7	46.7	80.7	79.8	78.3	77.2	72.6	60.0	47.2	47.0	46.8				
Energy Average		50.0	Average:		59.9	58.9	57.3	56.0	52.4	48.4	44.8	44.6	44.3				

## 24-Hour Noise Level Measurement Summary


Date: Wednesday, June 30, 2021  
Project: Edgemont Commerce Center

Location: L2 - Located north of the Project site on Bay Avenue near  
Source: single-family residence at 21948 Bay Avenue.

Meter: Piccolo II

JN: 13796  
Analyst: S. Shami

Hourly  $L_{eq}$  dBA Readings (unadjusted)

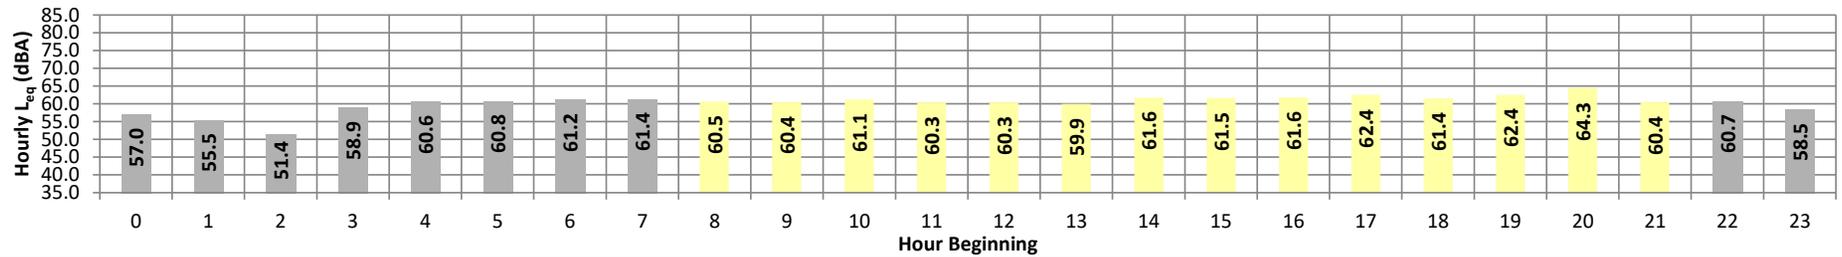

Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$	Adj.	Adj. $L_{eq}$	
Night	0	57.0	70.8	46.4	70.3	69.2	64.3	59.9	50.0	48.1	47.0	46.8	46.5	57.0	10.0	67.0	
	1	55.5	68.9	45.6	67.5	66.3	63.2	60.6	50.9	47.4	46.1	45.9	45.7	55.5	10.0	65.5	
	2	51.4	62.9	44.8	62.4	61.5	58.4	55.6	48.7	46.4	45.4	45.2	44.9	51.4	10.0	61.4	
	3	58.9	70.5	45.0	69.3	68.4	66.1	64.6	58.0	50.8	45.5	45.3	45.1	58.9	10.0	68.9	
	4	60.6	74.2	47.1	73.5	72.4	68.6	64.8	53.4	48.8	47.5	47.4	47.2	60.6	10.0	70.6	
	5	60.8	73.8	49.0	73.2	72.2	68.6	65.2	55.7	51.7	49.7	49.5	49.1	60.8	10.0	70.8	
	6	61.2	73.9	49.2	73.3	72.3	68.8	66.0	57.1	52.2	49.8	49.6	49.3	61.2	10.0	71.2	
Day	7	61.4	73.7	47.3	73.2	72.2	69.1	66.6	58.2	51.6	48.1	47.8	47.4	61.4	0.0	61.4	
	8	60.5	73.5	45.5	73.0	72.0	68.5	65.4	54.9	49.2	46.5	46.1	45.7	60.5	0.0	60.5	
	9	60.4	72.4	45.9	71.9	71.0	68.0	65.8	58.3	50.9	46.7	46.4	46.0	60.4	0.0	60.4	
	10	61.1	72.6	46.4	71.9	70.9	68.1	66.3	60.8	52.9	47.2	46.8	46.5	61.1	0.0	61.1	
	11	60.3	72.2	46.5	71.6	70.7	67.6	65.5	58.4	52.3	47.3	47.0	46.7	60.3	0.0	60.3	
	12	60.3	80.1	47.7	79.2	77.8	72.7	68.5	60.1	55.5	50.3	49.3	48.0	60.3	0.0	60.3	
	13	59.9	72.3	47.8	71.7	70.7	67.4	65.1	56.2	50.8	48.5	48.2	47.9	59.9	0.0	59.9	
	14	61.6	78.5	47.3	77.8	76.5	72.5	69.2	60.1	52.9	48.1	47.7	47.4	61.6	0.0	61.6	
	15	61.5	74.0	49.4	73.4	72.3	69.0	66.5	58.6	52.8	50.0	49.7	49.4	61.5	0.0	61.5	
	16	61.6	73.8	49.9	73.2	72.2	69.3	67.1	57.8	52.7	50.6	50.3	50.0	61.6	0.0	61.6	
	17	62.4	74.9	51.4	74.2	73.1	69.8	67.3	59.2	54.2	52.1	51.8	51.5	62.4	0.0	62.4	
	18	61.4	73.2	51.5	72.6	71.6	69.0	66.9	58.3	54.3	52.3	51.9	51.6	61.4	0.0	61.4	
	19	62.4	74.0	51.6	73.4	72.5	69.8	67.8	60.7	54.1	52.2	52.0	51.7	62.4	5.0	67.4	
	20	64.3	78.6	51.5	77.7	76.2	71.4	67.5	57.8	53.9	52.1	51.9	51.6	64.3	5.0	69.3	
	21	60.4	72.4	51.0	71.9	70.8	67.7	65.3	57.4	53.4	51.7	51.5	51.1	60.4	5.0	65.4	
Night	22	60.7	72.8	49.7	72.3	71.4	67.9	65.3	58.1	53.9	50.5	50.2	49.8	60.7	10.0	70.7	
	23	58.5	71.0	47.7	70.4	69.5	66.5	63.9	53.7	50.1	48.4	48.1	47.8	58.5	10.0	68.5	
Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$ (dBA)			
Day	Min	59.9	72.2	45.5	71.6	70.7	67.4	65.1	54.9	49.2	46.5	46.1	45.7	24-Hour	60.7	61.4	59.4
	Max	64.3	80.1	51.6	79.2	77.8	72.7	69.2	60.8	55.5	52.3	52.0	51.7				
Energy Average		61.5	Average:		73.8	72.7	69.3	66.7	58.5	52.9	49.7	49.3	48.9	Nighttime (10pm-8am)			
Night	Min	51.4	62.9	44.8	62.4	61.5	58.4	55.6	48.7	46.4	45.4	45.2	44.9				
	Max	61.4	74.2	49.7	73.5	72.4	69.1	66.6	58.2	53.9	50.5	50.2	49.8				
Energy Average		59.4	Average:		70.5	69.5	66.1	63.3	54.4	50.1	47.8	47.6	47.3				

## 24-Hour Noise Level Measurement Summary


Date: Wednesday, June 30, 2021  
Project: Edgemont Commerce Center

Location: L3 - Located at the eastern Project site boundary on Day  
Source: Street.

Meter: Piccolo II

JN: 13796  
Analyst: A. Khan

Hourly  $L_{eq}$  dBA Readings (unadjusted)

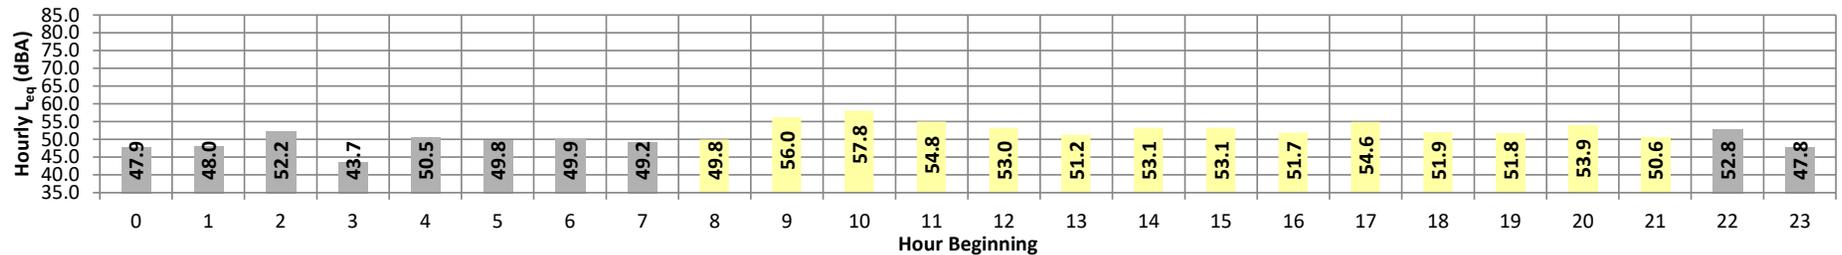

Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$	Adj.	Adj. $L_{eq}$	
Night	0	47.9	60.6	41.5	60.1	59.3	54.5	49.6	44.0	42.8	42.0	41.8	41.6	47.9	10.0	57.9	
	1	48.0	60.9	40.7	60.3	59.2	55.1	51.6	43.9	42.2	41.1	41.0	40.8	48.0	10.0	58.0	
	2	52.2	64.8	40.3	64.4	64.0	59.5	57.0	48.5	41.8	40.7	40.6	40.4	52.2	10.0	62.2	
	3	43.7	51.4	40.6	51.0	50.6	48.8	47.1	42.8	41.9	41.0	40.9	40.7	43.7	10.0	53.7	
	4	50.5	62.1	42.5	61.6	60.8	57.4	54.7	48.5	44.8	43.1	42.8	42.6	50.5	10.0	60.5	
	5	49.8	59.8	43.9	59.3	58.5	55.7	54.0	49.1	46.4	44.5	44.3	44.0	49.8	10.0	59.8	
	6	49.9	59.3	44.3	59.0	58.5	56.3	54.0	49.2	46.5	44.9	44.7	44.5	49.9	10.0	59.9	
	7	49.2	58.0	43.4	57.5	56.9	54.8	53.4	49.1	46.5	44.1	43.9	43.6	49.2	0.0	49.2	
Day	8	49.8	58.9	42.7	58.5	57.8	56.0	54.1	49.6	47.1	43.9	43.4	42.8	49.8	0.0	49.8	
	9	56.0	67.3	42.2	66.6	65.9	63.5	61.5	55.3	47.6	43.1	42.7	42.3	56.0	0.0	56.0	
	10	57.8	67.5	43.8	66.9	66.3	64.8	63.4	58.0	50.9	45.3	44.7	44.1	57.8	0.0	57.8	
	11	54.8	64.2	42.1	63.7	63.0	61.5	60.3	55.6	48.2	43.4	43.0	42.4	54.8	0.0	54.8	
	12	53.0	63.5	42.7	63.1	62.3	60.4	58.1	51.6	48.1	43.9	43.3	42.8	53.0	0.0	53.0	
	13	51.2	60.7	42.8	60.2	59.6	58.1	56.3	50.6	47.6	44.0	43.5	43.0	51.2	0.0	51.2	
	14	53.1	68.9	43.0	67.7	67.0	65.1	62.7	55.1	49.6	44.5	43.8	43.2	53.1	0.0	53.1	
	15	53.1	63.4	44.8	63.0	62.2	59.7	57.7	51.8	49.5	45.9	45.4	44.9	53.1	0.0	53.1	
	16	51.7	60.7	44.6	60.3	59.6	57.5	56.0	52.1	48.6	45.6	45.2	44.8	51.7	0.0	51.7	
	17	54.6	65.6	46.2	65.2	64.6	61.9	59.6	52.1	49.7	47.2	46.8	46.4	54.6	0.0	54.6	
	18	51.9	60.2	46.1	59.7	59.1	57.4	55.9	52.0	49.6	47.0	46.6	46.2	51.9	0.0	51.9	
	19	51.8	65.9	46.2	65.6	65.2	64.1	63.0	54.7	49.2	46.9	46.6	46.3	51.8	5.0	56.8	
	20	53.9	64.4	45.7	64.0	63.5	61.4	58.9	52.2	49.1	46.5	46.3	45.9	53.9	5.0	58.9	
	21	50.6	71.7	45.0	70.6	69.4	65.7	62.0	52.3	48.2	45.7	45.4	45.1	50.6	5.0	55.6	
Night	22	52.8	63.8	44.1	63.5	63.0	61.4	59.8	52.9	48.0	44.8	44.5	44.2	52.8	10.0	62.8	
Night	23	47.8	57.7	41.9	57.2	56.1	54.0	52.4	46.9	44.4	42.6	42.3	42.1	47.8	10.0	57.8	
Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$ (dBA)			
Day	Min	49.8	58.9	42.1	58.5	57.8	56.0	54.1	49.6	47.1	43.1	42.7	42.3	24-Hour	52.4	53.4	49.8
	Max	57.8	71.7	46.2	70.6	69.4	65.7	63.4	58.0	50.9	47.2	46.8	46.4				
Energy Average		53.6	Average:		63.9	63.3	61.2	59.3	53.1	48.8	45.2	44.8	44.3				
Night	Min	43.7	51.4	40.3	51.0	50.6	48.8	47.1	42.8	41.8	40.7	40.6	40.4				
	Max	52.8	64.8	44.3	64.4	64.0	61.4	59.8	52.9	48.0	44.9	44.7	44.5				
Energy Average		49.8	Average:		59.4	58.7	55.7	53.4	47.5	44.5	42.9	42.7	42.4				

## 24-Hour Noise Level Measurement Summary


Date: Wednesday, June 30, 2021  
Project: Edgemont Commerce Center

Location: L4 - Located at the southern Project site boundary on Day  
Source: Street near single-family residence at 13881 Day Street.

Meter: Piccolo II

JN: 13796  
Analyst: A. Khan

Hourly  $L_{eq}$  dBA Readings (unadjusted)

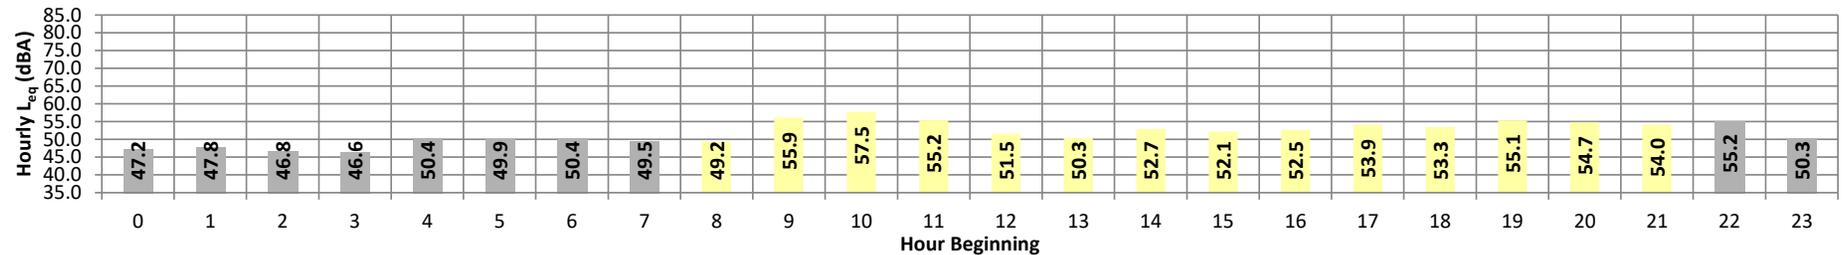

Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$	Adj.	Adj. $L_{eq}$	
Night	0	47.2	54.0	44.1	53.6	53.1	51.9	51.0	46.8	45.6	44.6	44.4	44.2	47.2	10.0	57.2	
	1	47.8	58.3	43.4	57.4	56.7	53.7	51.2	46.4	45.1	43.9	43.7	43.5	47.8	10.0	57.8	
	2	46.8	53.1	43.1	52.9	52.3	51.2	50.5	47.1	44.8	43.5	43.4	43.2	46.8	10.0	56.8	
	3	46.6	52.8	44.2	52.6	52.1	50.4	49.2	46.2	45.5	44.7	44.5	44.3	46.6	10.0	56.6	
	4	50.4	59.6	45.2	59.0	58.4	57.1	55.4	49.4	47.4	45.7	45.5	45.3	50.4	10.0	60.4	
	5	49.9	57.4	45.1	57.0	56.5	55.0	53.7	50.1	47.9	45.8	45.5	45.3	49.9	10.0	59.9	
	6	50.4	56.9	46.9	56.6	56.2	54.8	53.8	50.6	48.9	47.4	47.2	47.0	50.4	10.0	60.4	
Day	7	49.5	56.1	45.3	55.8	55.4	54.2	52.9	49.8	48.0	45.9	45.6	45.4	49.5	0.0	49.5	
	8	49.2	57.3	43.5	56.8	56.1	54.1	52.7	49.7	47.2	44.3	44.0	43.6	49.2	0.0	49.2	
	9	55.9	64.8	43.5	64.5	64.0	62.9	61.7	56.5	48.5	44.2	43.9	43.6	55.9	0.0	55.9	
	10	57.5	66.7	44.2	66.3	65.9	64.8	63.5	57.5	50.3	45.5	44.8	44.3	57.5	0.0	57.5	
	11	55.2	64.4	44.0	63.9	63.4	62.0	60.8	55.9	48.5	44.9	44.5	44.1	55.2	0.0	55.2	
	12	51.5	60.2	44.8	59.9	59.3	57.6	56.0	51.2	48.5	45.8	45.4	44.9	51.5	0.0	51.5	
	13	50.3	58.1	44.9	57.7	57.2	55.5	54.3	50.6	48.4	45.8	45.4	45.0	50.3	0.0	50.3	
	14	52.7	68.8	44.8	68.2	67.7	65.9	64.4	55.8	49.8	46.0	45.5	44.9	52.7	0.0	52.7	
	15	52.1	59.8	46.7	59.4	58.7	57.2	55.9	52.5	50.1	47.6	47.2	46.8	52.1	0.0	52.1	
	16	52.5	59.2	47.1	58.8	58.4	57.5	56.8	53.0	50.1	48.0	47.6	47.2	52.5	0.0	52.5	
	17	53.9	62.6	48.9	62.4	61.9	59.8	58.0	53.0	51.4	49.6	49.3	49.0	53.9	0.0	53.9	
	18	53.3	59.6	49.2	59.2	58.7	57.4	56.5	53.8	52.0	50.0	49.7	49.4	53.3	0.0	53.3	
	19	55.1	67.7	49.5	67.4	67.0	65.7	64.3	59.3	52.1	50.2	49.9	49.6	55.1	5.0	60.1	
	20	54.7	63.5	49.6	63.1	62.3	60.1	58.4	54.3	52.1	50.4	50.0	49.7	54.7	5.0	59.7	
	21	54.0	65.4	49.2	65.1	64.6	63.3	61.4	55.1	51.5	49.8	49.6	49.3	54.0	5.0	59.0	
Night	22	55.2	63.5	47.3	63.2	62.8	61.6	60.6	55.3	51.1	48.2	47.8	47.4	55.2	10.0	65.2	
	23	50.3	59.7	45.5	59.1	58.5	56.0	54.0	49.5	47.7	46.2	46.0	45.6	50.3	10.0	60.3	
Timeframe	Hour	$L_{eq}$	$L_{max}$	$L_{min}$	L1%	L2%	L5%	L8%	L25%	L50%	L90%	L95%	L99%	$L_{eq}$ (dBA)			
Day	Min	49.2	57.3	43.5	56.8	56.1	54.1	52.7	49.7	47.2	44.2	43.9	43.6	24-Hour	52.8	53.8	50.2
	Max	57.5	68.8	49.6	68.2	67.7	65.9	64.4	59.3	52.1	50.4	50.0	49.7				
Energy Average		54.0	Average:		62.3	61.8	60.3	58.9	54.2	50.0	47.3	46.9	46.5				
Night	Min	46.6	52.8	43.1	52.6	52.1	50.4	49.2	46.2	44.8	43.5	43.4	43.2				
	Max	55.2	63.5	47.3	63.2	62.8	61.6	60.6	55.3	51.1	48.2	47.8	47.4				
Energy Average		50.2	Average:		56.7	56.2	54.6	53.2	49.1	47.2	45.6	45.4	45.1				

**APPENDIX 7.1:**  
**CADNAA OPERATIONAL NOISE MODEL INPUTS**

*This page intentionally left blank*

# 13796 - Edgemont Commerce Center

CadnaA Noise Prediction Model: 13796-16\_Mitigated.cna

Date: 25.05.23

Analyst: B. Lawson

## Calculation Configuration

Configuration	
Parameter	Value
<b>General</b>	
Max. Error (dB)	0.00
Max. Search Radius #(Unit,LEN)	2000.01
Min. Dist Src to Rcvr	0.00
<b>Partition</b>	
Raster Factor	0.50
Max. Length of Section #(Unit,LEN)	999.99
Min. Length of Section #(Unit,LEN)	1.01
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
<b>Ref. Time</b>	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
<b>DTM</b>	
Standard Height (m)	0.00
Model of Terrain	Triangulation
<b>Reflection</b>	
max. Order of Reflection	2
Search Radius Src	100.00
Search Radius Rcvr	100.00
Max. Distance Source - Rcvr	1000.00 1000.00
Min. Distance Rcvr - Reflector	1.00 1.00
Min. Distance Source - Reflector	0.10
<b>Industrial (ISO 9613)</b>	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
<b>Screening</b>	
	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature #(Unit,TEMP)	10
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. #(Unit,SPEED)	3.0
<b>Roads (TNM)</b>	
<b>Railways (FTA/FRA)</b>	
<b>Aircraft (???)</b>	
Strictly acc. to AzB	

## Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		X	Y	Z	
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				(ft)	(ft)	(ft)		
RECEIVERS	R1		49.4	49.3	56.0	65.0	60.0	0.0				5.00	r	6249109.06	2280186.68	1555.00
RECEIVERS	R2		43.3	42.6	49.3	65.0	60.0	0.0				5.00	r	6249592.10	2279840.88	1562.00
RECEIVERS	R3		52.3	52.1	58.7	65.0	60.0	0.0				5.00	r	6249461.70	2279448.16	1568.87
RECEIVERS	R4		52.6	52.5	59.2	65.0	60.0	0.0				5.00	r	6249049.93	2279276.23	1546.45
RECEIVERS	R5		52.5	52.4	59.1	65.0	60.0	0.0				5.00	r	6248738.80	2280175.72	1552.65
RECEIVERS	@200		52.5	52.5	59.2	65.0	60.0	0.0				5.00	r	6248918.32	2279269.70	1544.00

## Point Source(s)

Name	M.	ID	Result. PWL			Lw / Li		Operating Time			Height	Coordinates			
			Day	Evening	Night	Type	Value	norm.	Day	Special		Night	X	Y	Z
			(dBA)	(dBA)	(dBA)		dB(A)	(min)	(min)	(min)	(ft)	(ft)	(ft)	(ft)	
POINTSOURCE		AC01	88.9	88.9	88.9	Lw	88.9	585.00	0.00	252.00	5.00	g	6249387.59	2279983.82	1599.63
POINTSOURCE		AC02	88.9	88.9	88.9	Lw	88.9	585.00	0.00	252.00	5.00	g	6249388.37	2280044.09	1599.63
POINTSOURCE		AC03	88.9	88.9	88.9	Lw	88.9	585.00	0.00	252.00	5.00	g	6249383.67	2279551.70	1599.63
POINTSOURCE		AC04	88.9	88.9	88.9	Lw	88.9	585.00	0.00	252.00	5.00	g	6249382.89	2279602.58	1599.63
POINTSOURCE		CAR01	79.0	79.0	79.0	Lw	79				5.00	r	6249470.87	2279558.71	1563.63
POINTSOURCE		CAR02	79.0	79.0	79.0	Lw	79				5.00	r	6249423.60	2279587.71	1562.00
POINTSOURCE		CAR03	79.0	79.0	79.0	Lw	79				5.00	r	6249470.57	2279625.28	1561.75
POINTSOURCE		CAR04	79.0	79.0	79.0	Lw	79				5.00	r	6249424.38	2279658.95	1559.52
POINTSOURCE		CAR05	79.0	79.0	79.0	Lw	79				5.00	r	6249472.13	2279696.52	1558.78
POINTSOURCE		CAR06	79.0	79.0	79.0	Lw	79				5.00	r	6249427.51	2279736.45	1556.83
POINTSOURCE		CAR07	79.0	79.0	79.0	Lw	79				5.00	r	6249473.70	2279774.02	1557.00
POINTSOURCE		CAR08	79.0	79.0	79.0	Lw	79				5.00	r	6249427.51	2279813.16	1556.78
POINTSOURCE		CAR09	79.0	79.0	79.0	Lw	79				5.00	r	6249474.48	2279848.39	1559.31
POINTSOURCE		CAR10	79.0	79.0	79.0	Lw	79				5.00	r	6249429.08	2279909.45	1558.11

Name	M.	ID	Result. PWL			Lw / Li		Operating Time			Height		Coordinates			
			Day (dBA)	Evening (dBA)	Night (dBA)	Type	Value (dB(A))	norm.	Day (min)	Special (min)	Night (min)	(ft)		X (ft)	Y (ft)	Z (ft)
POINTSOURCE		CAR11	79.0	79.0	79.0	Lw	79					5.00	r	6249475.26	2279943.89	1558.24
POINTSOURCE		CAR12	79.0	79.0	79.0	Lw	79					5.00	r	6249432.21	2279980.68	1557.00
POINTSOURCE		CAR13	79.0	79.0	79.0	Lw	79					5.00	r	6249476.83	2280018.26	1557.87
POINTSOURCE		CAR14	79.0	79.0	79.0	Lw	79					5.00	r	6249432.99	2280054.27	1557.14
POINTSOURCE		TRASH01	89.0	89.0	89.0	Lw	89		900.00	0.00	270.00	5.00	r	6248888.15	2279492.21	1552.00

### Line Source(s)

Name	M.	ID	Result. PWL			Result. PWL'			Lw / Li		Operating Time			Moving Pt. Src			Height			
			Day (dBA)	Evening (dBA)	Night (dBA)	Day (dBA)	Evening (dBA)	Night (dBA)	Type	Value (dB(A))	norm.	Day (min)	Special (min)	Night (min)	Day	Evening	Night	Number (mph)	Speed (ft)	Height (ft)
LINESOURCE		TRUCK01	93.2	93.2	93.2	78.2	78.2	78.2	Lw	93.2									8	r
LINESOURCE		TRUCK02	93.2	93.2	93.2	72.0	72.0	72.0	Lw	93.2									8	r

Name	ID	Height		Coordinates					
		Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)		
LINESOURCE	TRUCK01	8.00	r			6248972.77	2279982.72	1555.64	1547.64
						6248974.94	2280087.45	1554.00	1546.00
LINESOURCE	TRUCK02	8.00	r			6249063.48	2279497.72	1556.35	1548.35
						6249378.98	2279494.55	1561.48	1553.48
						6249441.60	2279516.47	1565.36	1557.36
						6249495.55	2279516.44	1568.00	1560.00

### Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL''			Lw / Li		Operating Time			Height (ft)	
			Day (dBA)	Evening (dBA)	Night (dBA)	Day (dBA)	Evening (dBA)	Night (dBA)	Type	Value (dB(A))	norm.	Day (min)	Special (min)		Night (min)
AREASOURCE		DOCK01	111.5	111.5	111.5	70.7	70.7	70.7	Lw	111.5				8	r

Name	ID	Height		Coordinates					
		Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)		
AREASOURCE	DOCK01	8.00	r			6248737.36	2280070.94	1555.39	1547.39
						6248947.52	2280068.85	1555.16	1547.16
						6248945.96	2279983.18	1555.00	1547.00
						6249068.87	2279981.09	1560.00	1552.00
						6249063.67	2279512.86	1556.74	1548.74
						6249063.15	2279471.28	1554.84	1546.84
						6248879.55	2279474.67	1550.59	1542.59
						6248882.16	2279669.98	1548.44	1540.44
						6248885.02	2279870.76	1553.11	1545.11
						6248885.02	2279880.14	1554.62	1546.62
						6248733.98	2279880.66	1551.56	1543.56

### Barrier(s)

Name	Sel.	M.	ID	Absorption		Z-Ext.	Cantilever			Height		Coordinates			
				left	right		horz.	vert.	Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)	
BARRIERTEMP			0							14.00	r	6248734.36	2280072.01	1561.22	1547.22
												6248948.95	2280069.66	1561.09	1547.09
												6248947.25	2279984.60	1561.03	1547.03
												6248953.89	2279984.47	1561.73	1547.73
BARRIERTEMP			0							14.00	r	6248993.87	2279983.82	1561.94	1547.94
												6249009.49	2279983.69	1562.77	1548.77
BARRIERTEMP			0							10.00	r	6249062.62	2279470.67	1556.71	1546.71
												6248877.12	2279472.41	1550.90	1540.90

### Building(s)

Name	Sel.	M.	ID	RB	Residents	Absorption	Height	Coordinates				
								Begin (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)
BUILDING			BUILDING00001	x	0		45.00	r	6249011.37	2280069.73	1594.63	1549.63
									6249394.29	2280067.38	1594.63	1552.14
									6249408.39	2280063.47	1594.63	1552.70
									6249402.91	2279534.89	1594.63	1552.70
									6249366.10	2279522.36	1594.63	1552.00
									6249064.62	2279526.27	1594.63	1552.00
									6249070.10	2279982.03	1594.63	1552.00
									6249009.80	2279983.59	1594.63	1548.78

**APPENDIX 8.1:**  
**CADNAA CONSTRUCTION NOISE MODEL INPUTS**

*This page intentionally left blank*

# 13796 - Edgemont Commerce Center

CadnaA Noise Prediction Model: 13796-15\_Construction.cna

Date: 17.05.23

Analyst: B. Lawson

## Calculation Configuration

Configuration	
Parameter	Value
<b>General</b>	
Max. Error (dB)	0.00
Max. Search Radius #(Unit,LEN)	2000.01
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section #(Unit,LEN)	999.99
Min. Length of Section #(Unit,LEN)	1.01
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
<b>Reflection</b>	
max. Order of Reflection	2
Search Radius Src	100.00
Search Radius Rcvr	100.00
Max. Distance Source - Rcvr	1000.00 1000.00
Min. Distance Rcvr - Reflector	1.00 1.00
Min. Distance Source - Reflector	0.10
Industrial (ISO 9613)	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature #(Unit,TEMP)	10
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. #(Unit,SPEED)	3.0
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

## Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		X	Y	Z	
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				(ft)	(ft)	(ft)		
RECEIVERS		R1	68.8	-38.2	65.8	65.0	60.0	0.0				5.00	r	6249109.06	2280186.68	1555.00
RECEIVERS		R2	68.6	-38.4	65.6	65.0	60.0	0.0				5.00	r	6249592.10	2279840.88	1562.00
RECEIVERS		R3	72.6	-34.4	69.6	65.0	60.0	0.0				5.00	r	6249461.70	2279448.16	1568.87
RECEIVERS		R4	64.5	-42.5	61.5	65.0	60.0	0.0				5.00	r	6249049.93	2279276.23	1546.45
RECEIVERS		R6	67.8	-39.2	64.8	65.0	60.0	0.0				5.00	r	6248738.80	2280175.72	1552.65
RECEIVERS		@200	63.6	-43.4	60.6	65.0	60.0	0.0				5.00	r	6248918.32	2279269.70	1544.00

## Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL''			Lw / Li		Operating Time			Height	
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special		Night
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)		dB(A)	(min)	(min)	(min)	(ft)	
SITEBOUNDARY		CONSTRUCTION01	122.0	15.0	15.0	76.0	-31.0	-31.0	PWL-Pt	115				8	r

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
SITEBOUNDARY	CONSTRUCTION01	8.00	r	6248734.71	2280093.95	1553.55	1545.55
				6248939.57	2280092.22	1554.05	1546.05
				6248943.91	2280087.88	1554.10	1546.10
				6249006.84	2280087.01	1554.00	1546.00
				6249010.75	2280091.35	1554.00	1546.00
				6249485.14	2280087.88	1566.60	1558.60
				6249507.71	2280064.01	1571.00	1563.00
				6249505.11	2279900.60	1566.00	1558.00
				6249500.77	2279900.81	1566.00	1558.00

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
				6249500.55	2279857.63	1564.00	1556.00
				6249504.67	2279856.54	1563.93	1555.93
				6249500.33	2279552.72	1568.00	1560.00
				6249495.78	2279549.47	1568.00	1560.00
				6249495.34	2279485.66	1568.30	1560.30
				6249499.25	2279482.19	1568.28	1560.28
				6249498.60	2279467.87	1569.99	1561.99
				6248876.11	2279472.04	1548.37	1540.37
				6248882.63	2279877.24	1554.35	1546.35
				6248731.32	2279878.29	1551.54	1543.54

## **APPENDIX 8.2:**

### **CADNAA NIGHTTIME CONCRETE POUR NOISE MODEL INPUTS**

*This page intentionally left blank*

# 13796 - Edgemont Commerce Center

CadnaA Noise Prediction Model: 13796-15\_Concrete.cna

Date: 17.05.23

Analyst: B. Lawson

## Calculation Configuration

Configuration	
Parameter	Value
<b>General</b>	
Max. Error (dB)	0.00
Max. Search Radius #(Unit,LEN)	2000.01
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section #(Unit,LEN)	999.99
Min. Length of Section #(Unit,LEN)	1.01
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	100.00
Search Radius Rcvr	100.00
Max. Distance Source - Rcvr	1000.00 1000.00
Min. Distance Rcvr - Reflector	1.00 1.00
Min. Distance Source - Reflector	0.10
Industrial (ISO 9613)	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature #(Unit,TEMP)	10
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. #(Unit,SPEED)	3.0
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

## Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		X	Y	Z	
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				(ft)	(ft)	(ft)	(ft)	
RECEIVERS		R1	54.9	-52.1	51.9	65.0	60.0	0.0				5.00	r	6249109.06	2280186.68	1555.00
RECEIVERS		R2	52.8	-54.2	49.8	65.0	60.0	0.0				5.00	r	6249592.10	2279840.88	1562.00
RECEIVERS		R3	54.7	-52.3	51.7	65.0	60.0	0.0				5.00	r	6249461.70	2279448.16	1568.87
RECEIVERS		R4	48.5	-58.5	45.4	65.0	60.0	0.0				5.00	r	6249049.93	2279276.23	1546.45
RECEIVERS		R5	49.3	-57.7	46.3	65.0	60.0	0.0				5.00	r	6248738.80	2280175.72	1552.65
RECEIVERS		@200	46.9	-60.1	43.9	65.0	60.0	0.0				5.00	r	6248918.32	2279269.70	1544.00

## Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL"			Lw / Li		Operating Time			Height	
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special		Night
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)			(min)	(min)	(min)	(ft)	
BUILDING		CONCRETE01	107.3	0.3	0.3	64.8	-42.2	-42.2	PWL-Pt	100.3				8	r

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
BUILDING	CONCRETE01	8.00	r	6249011.37	2280069.73	1557.63	1549.63
				6249394.29	2280067.38	1560.14	1552.14
				6249408.39	2280063.47	1560.70	1552.70
				6249402.91	2279534.89	1560.70	1552.70
				6249366.10	2279522.36	1560.00	1552.00
				6249064.62	2279526.27	1560.00	1552.00
				6249070.10	2279982.03	1560.00	1552.00
				6249009.80	2279983.59	1556.78	1548.78

*This page intentionally left blank*